



Average Energy Prices DA vs. RT


ERCOT-wide

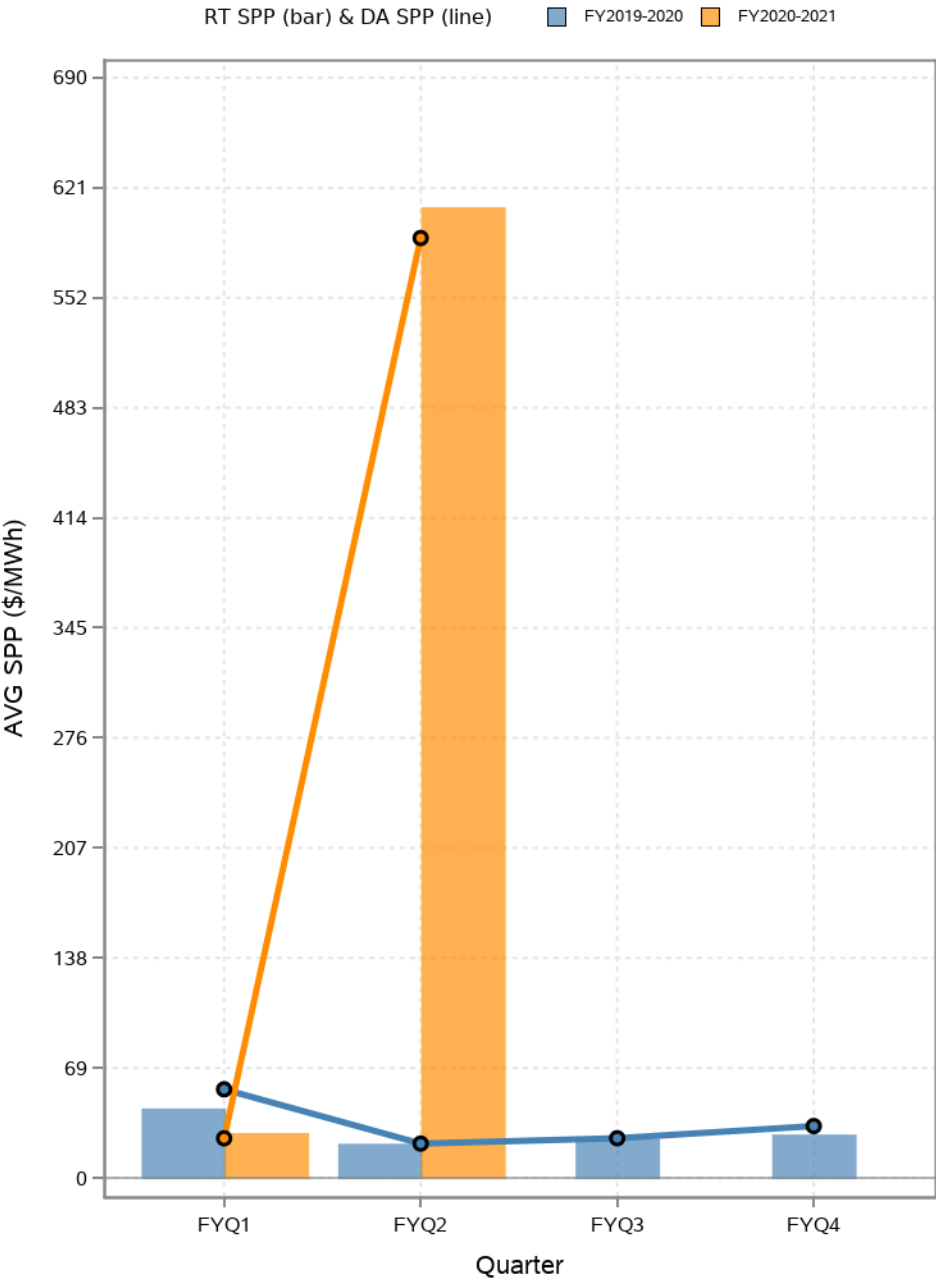


LZ Houston

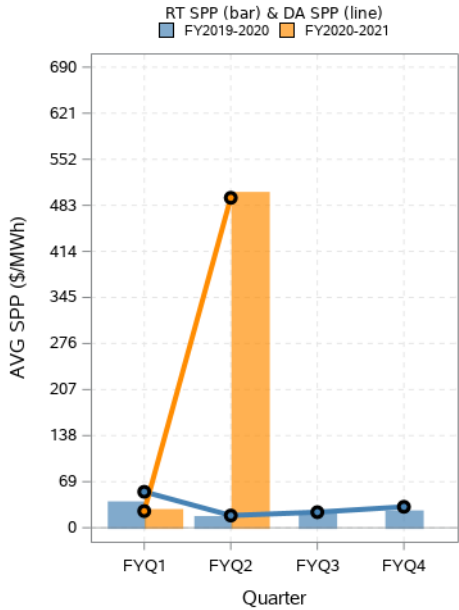


LZ North

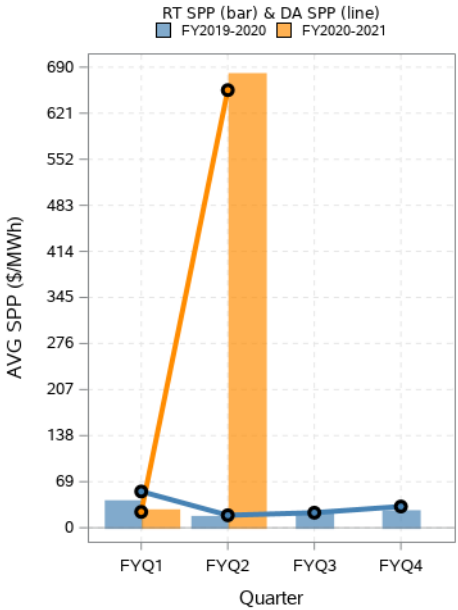

LZ South

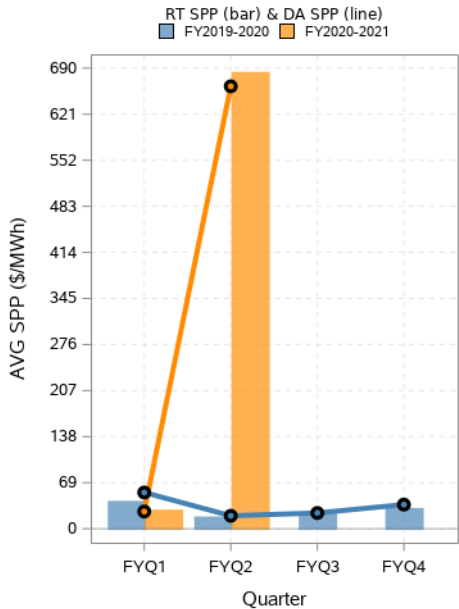


LZ West

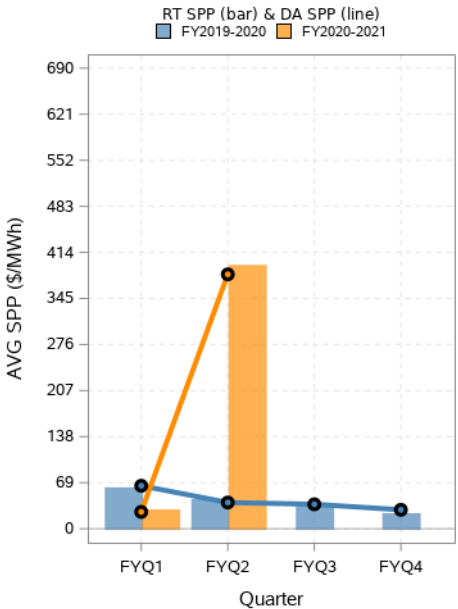


Average Heat Rates DA vs. RT


ERCOT-wide

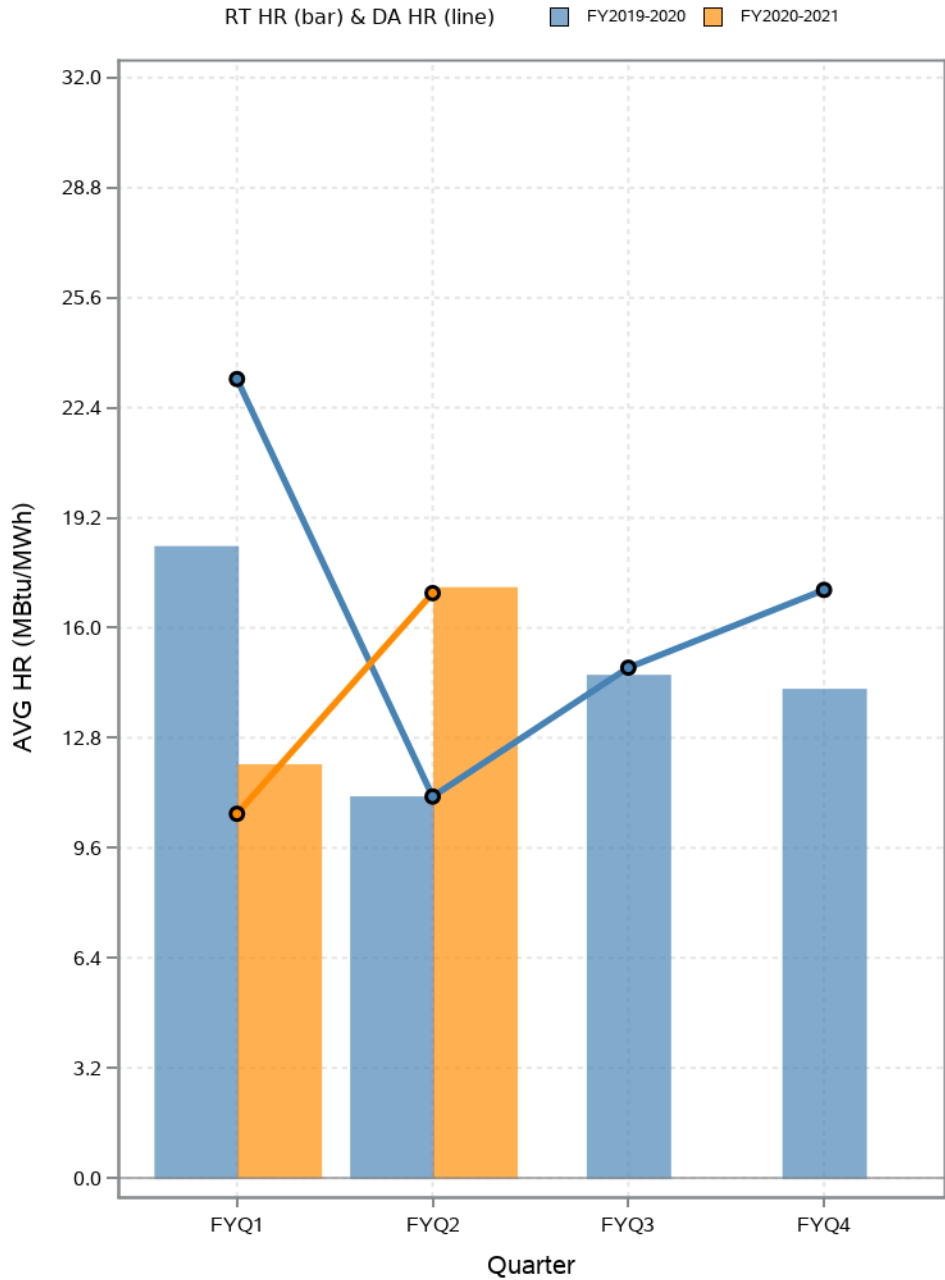


LZ Houston

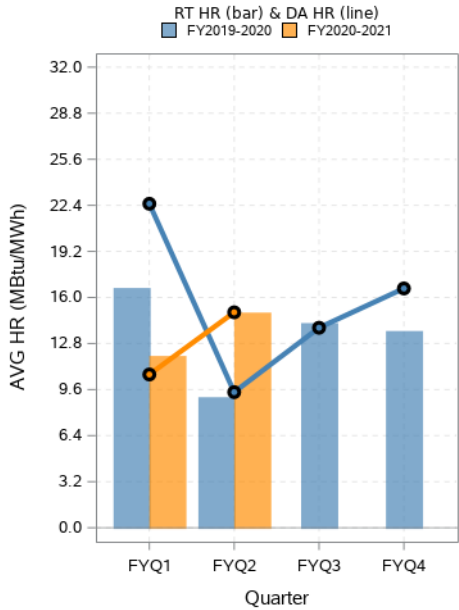


LZ North

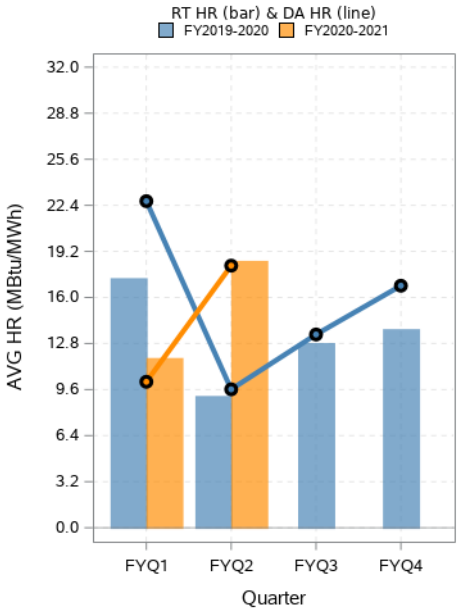

LZ South

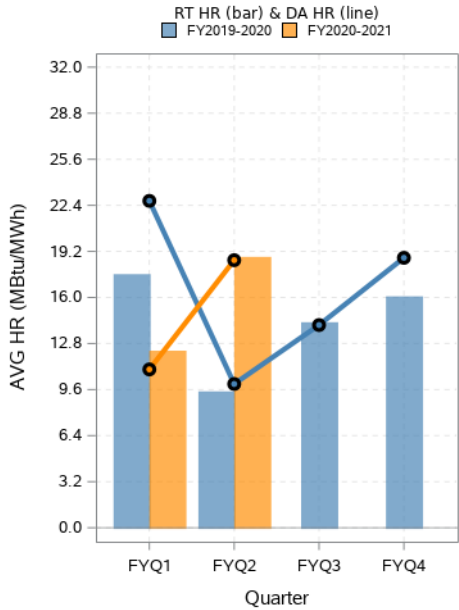


LZ West

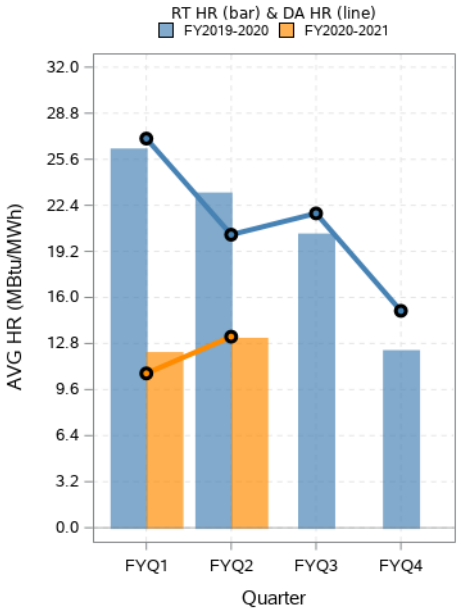


Load Zone Loads Averages vs. Peaks


LZ Houston

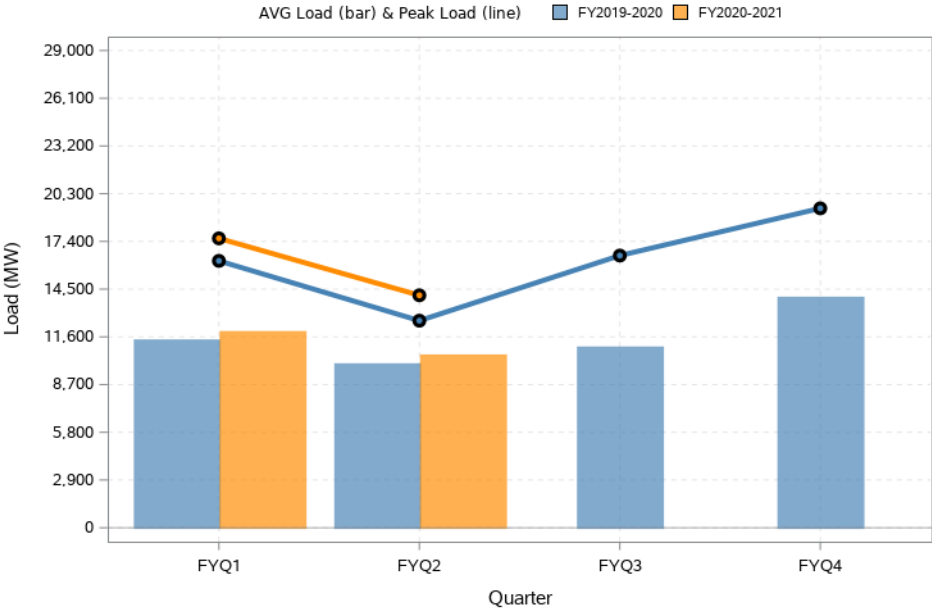


LZ North

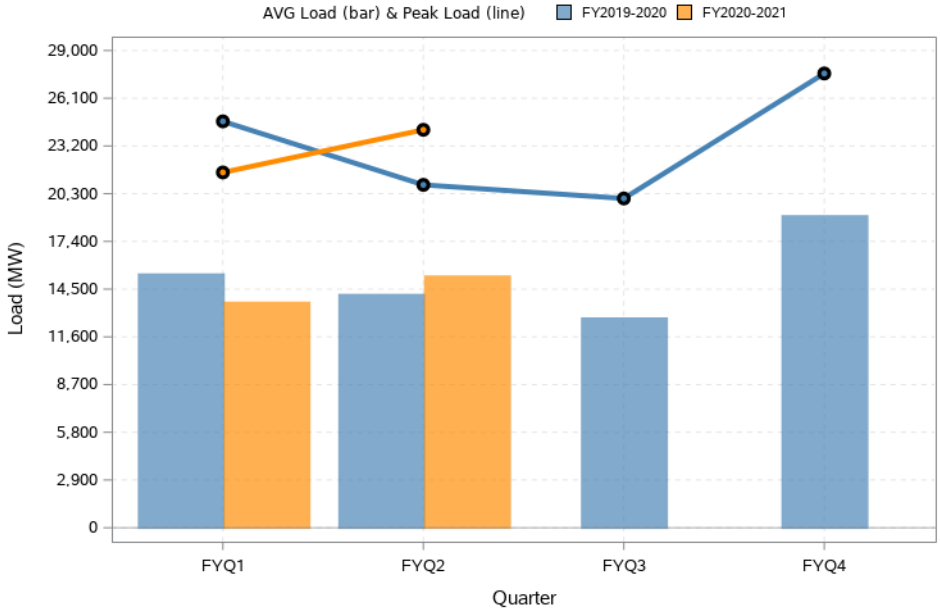



LZ South

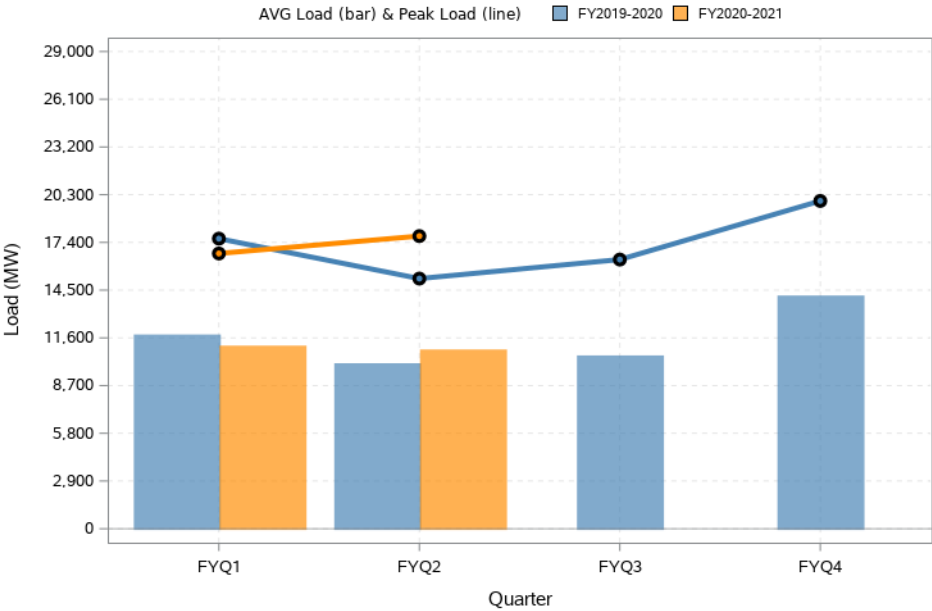





LZ West

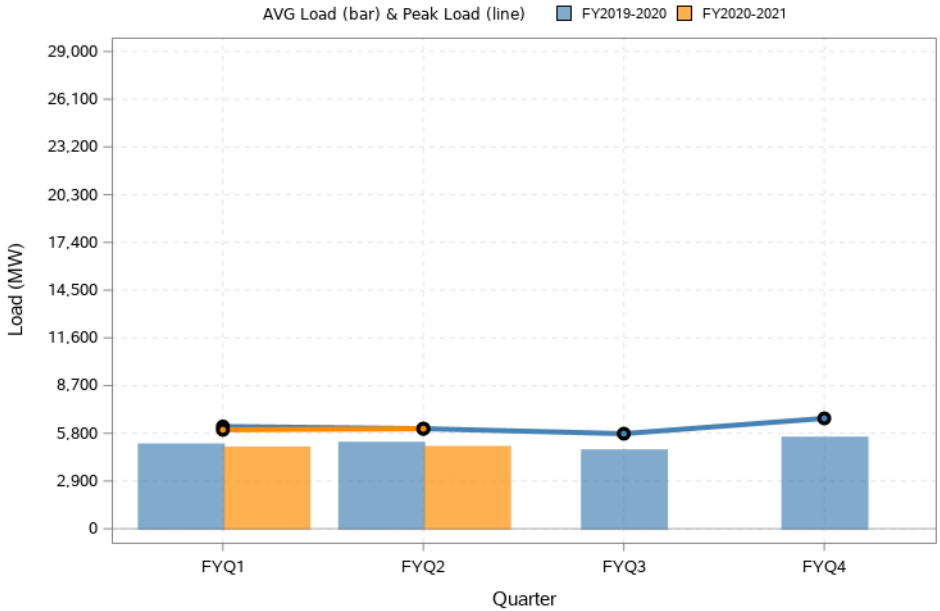





Daily ORDC Reserve/Reliability Adders Average Values in FY2020-2021Q2

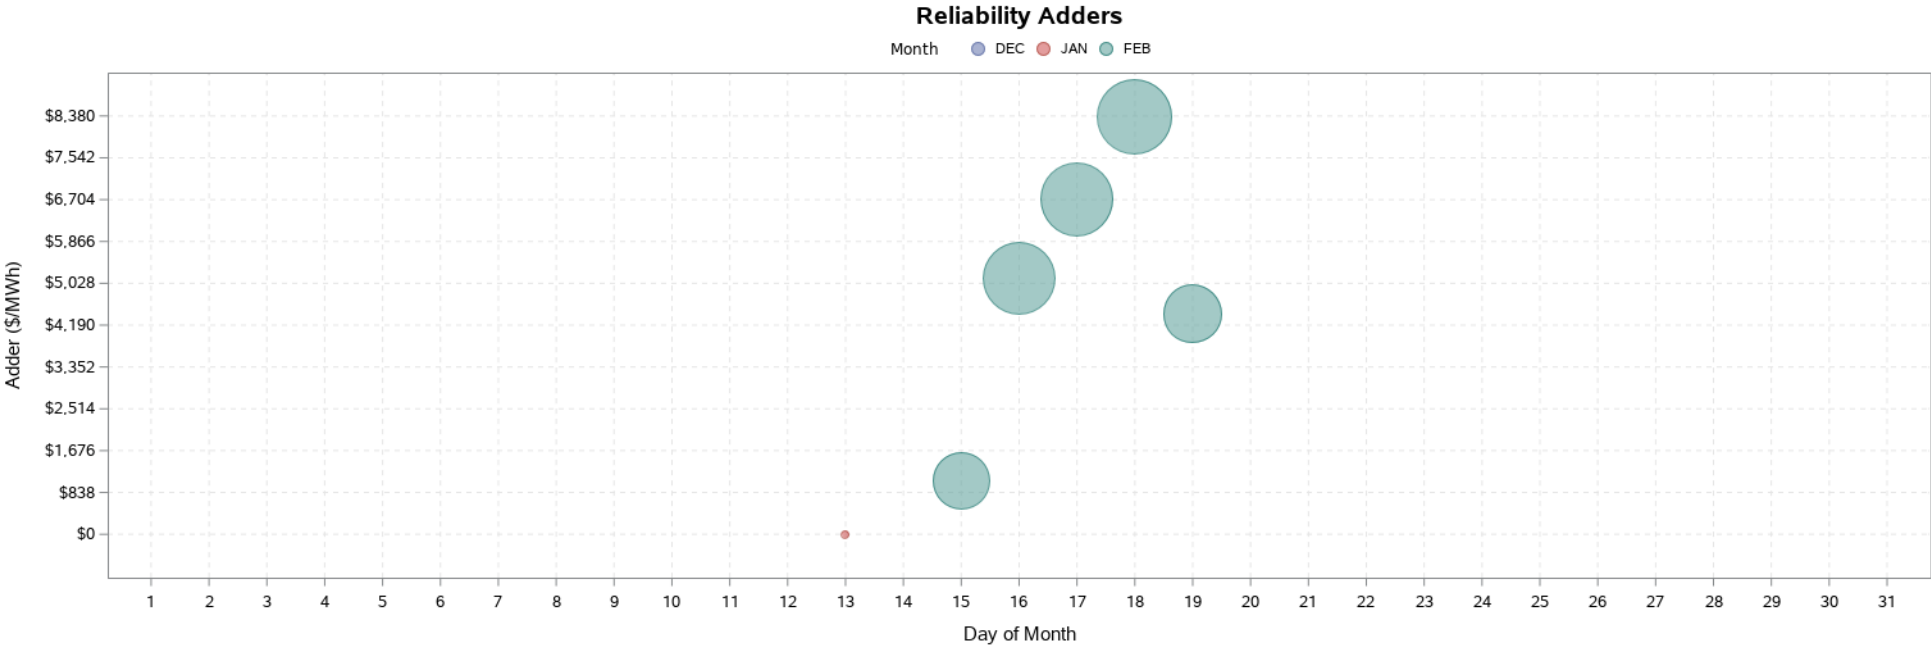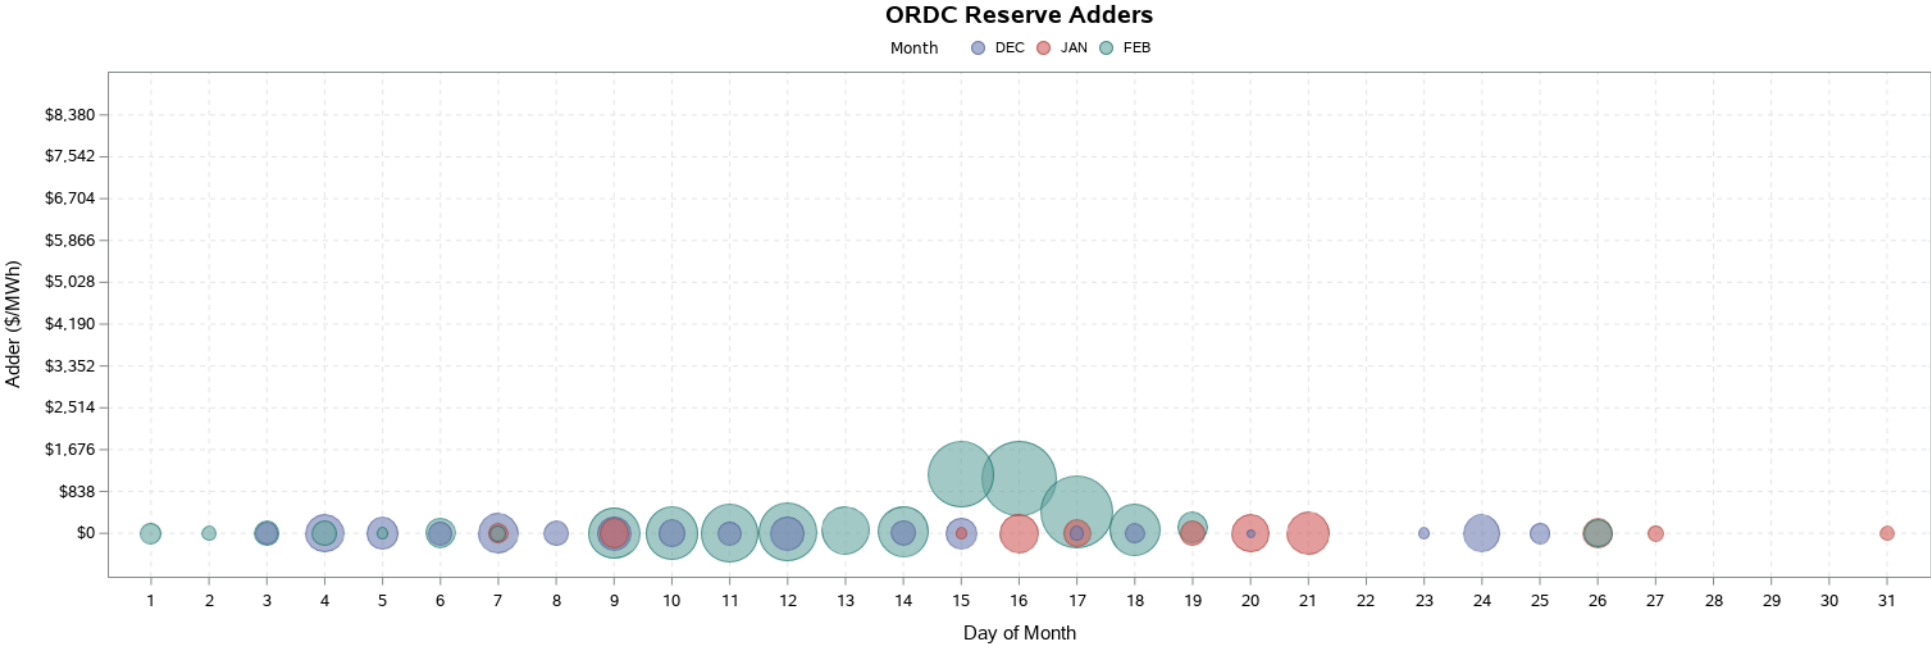


Quarterly Average of Ancillary Services Required MW

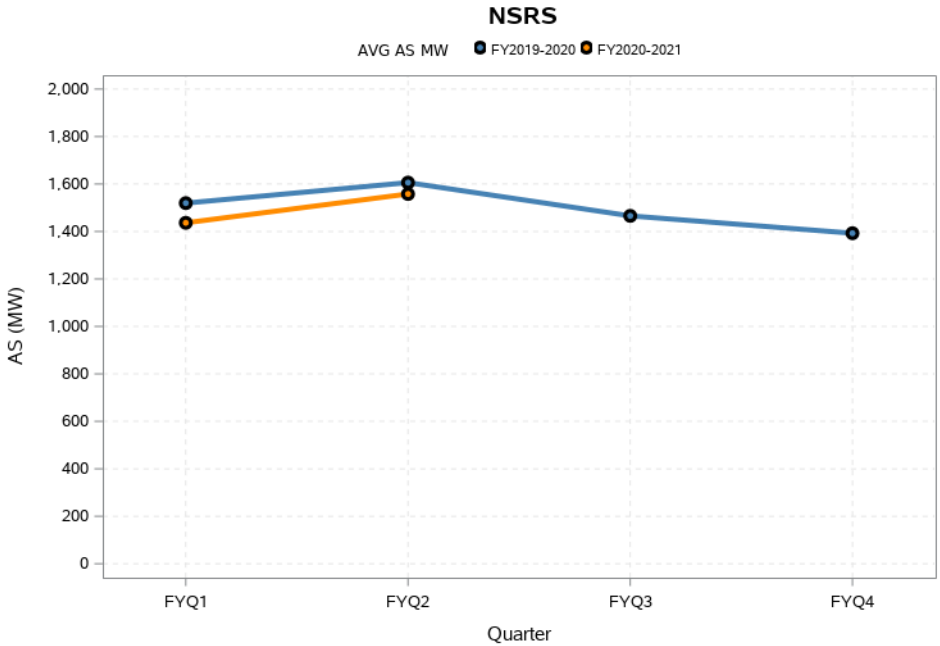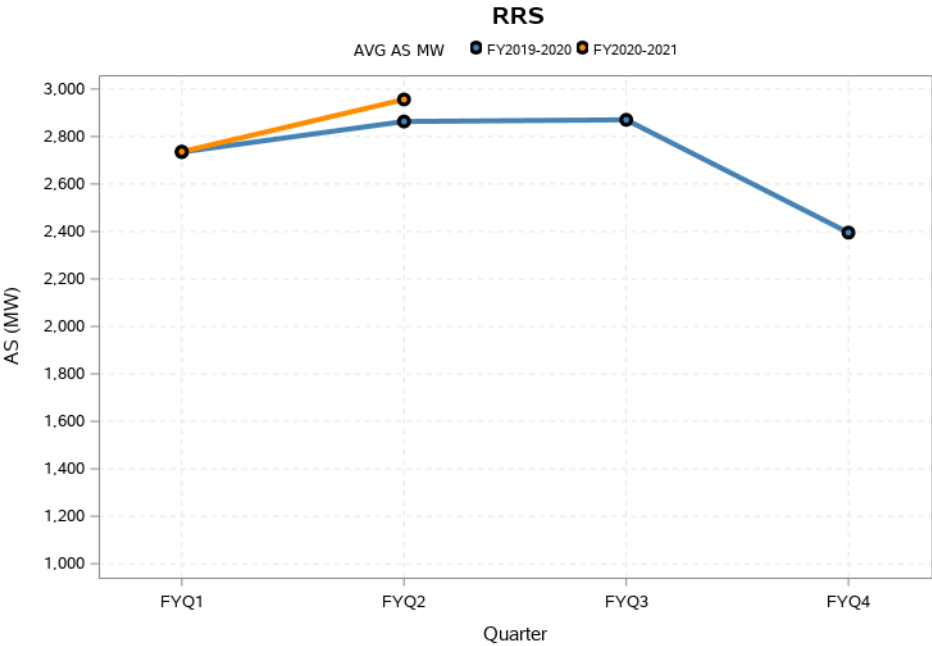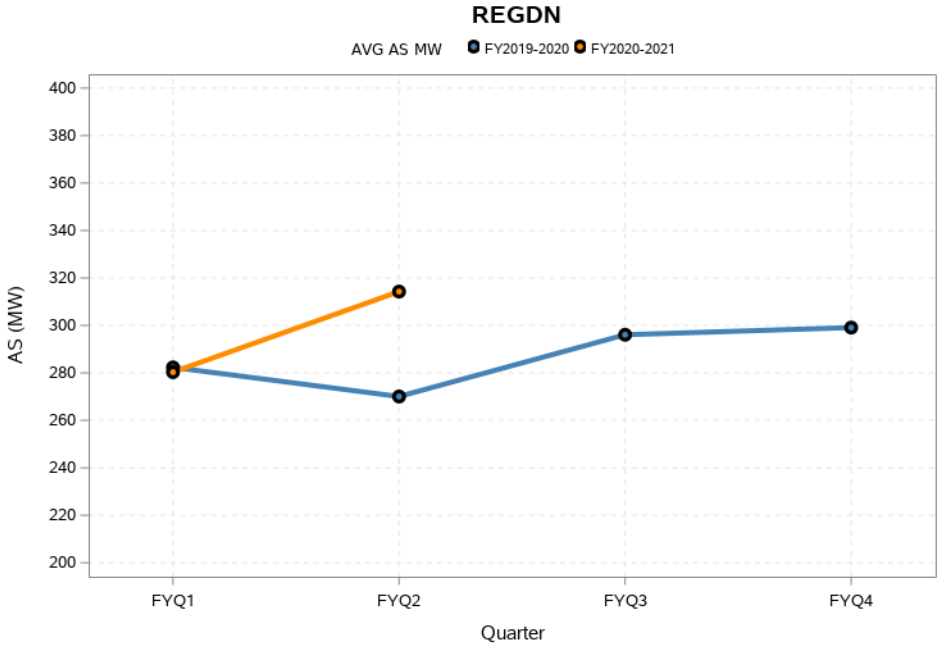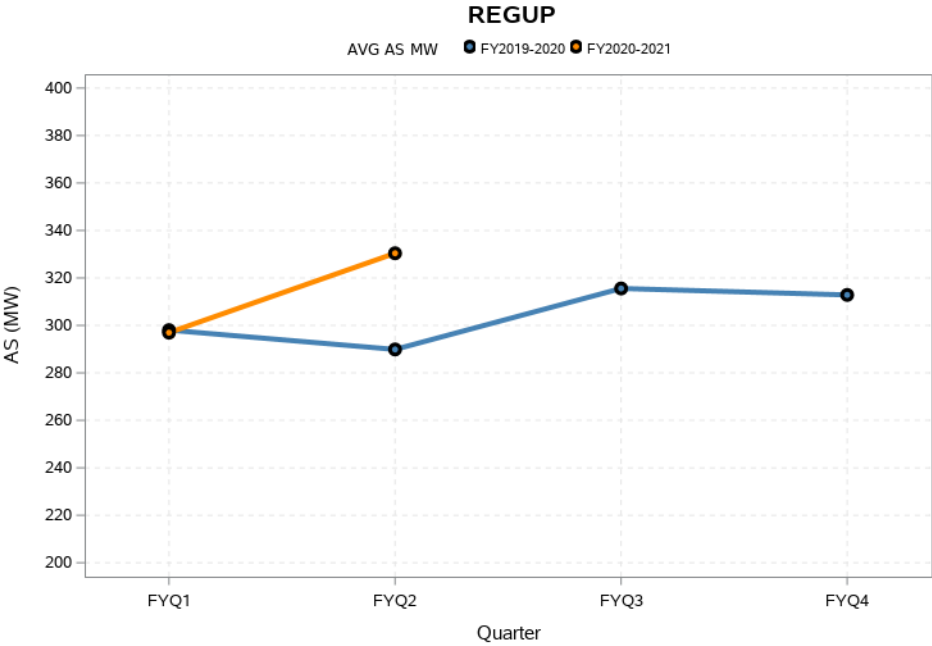


Quarterly Average of Ancillary Services Prices (MCPCs)

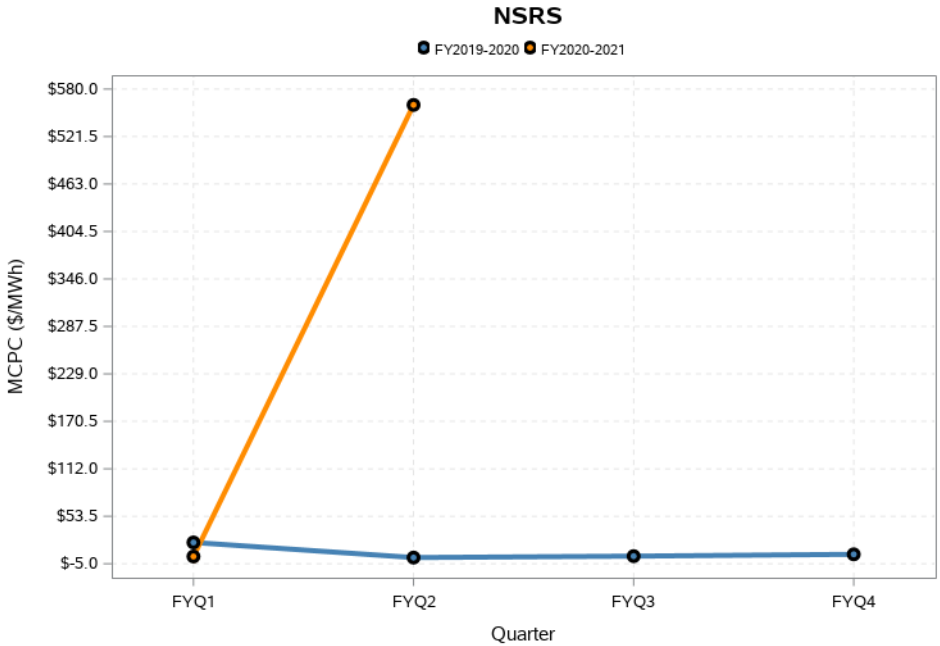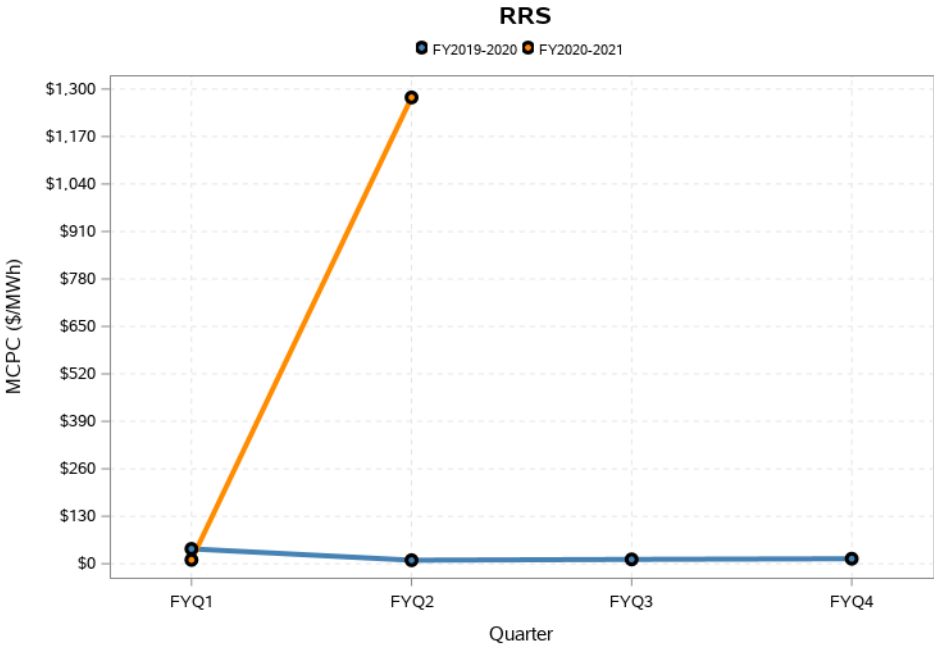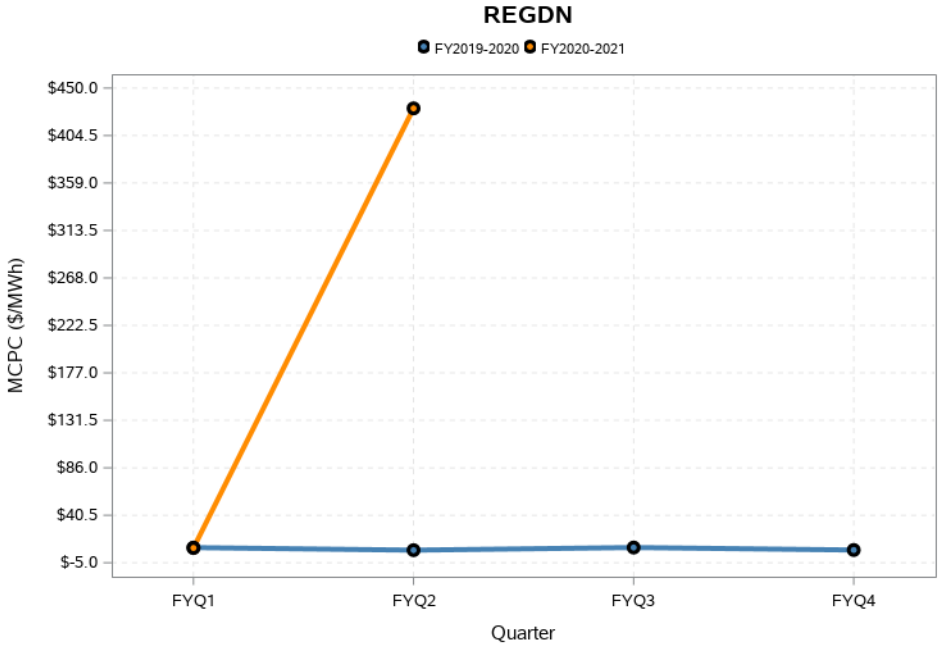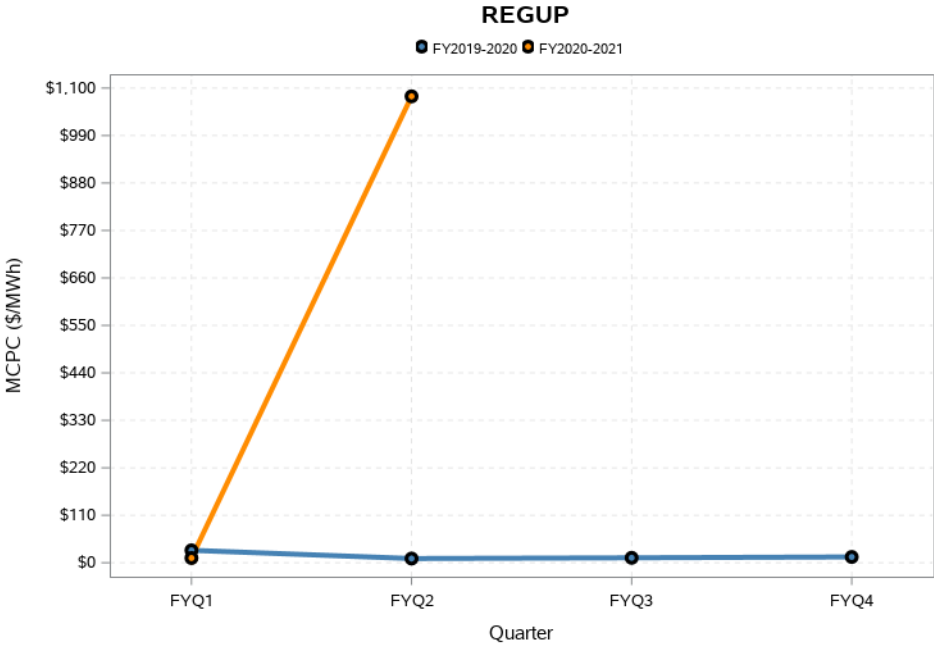

Quarterly Average Ancillary Services Cost per MWh Load

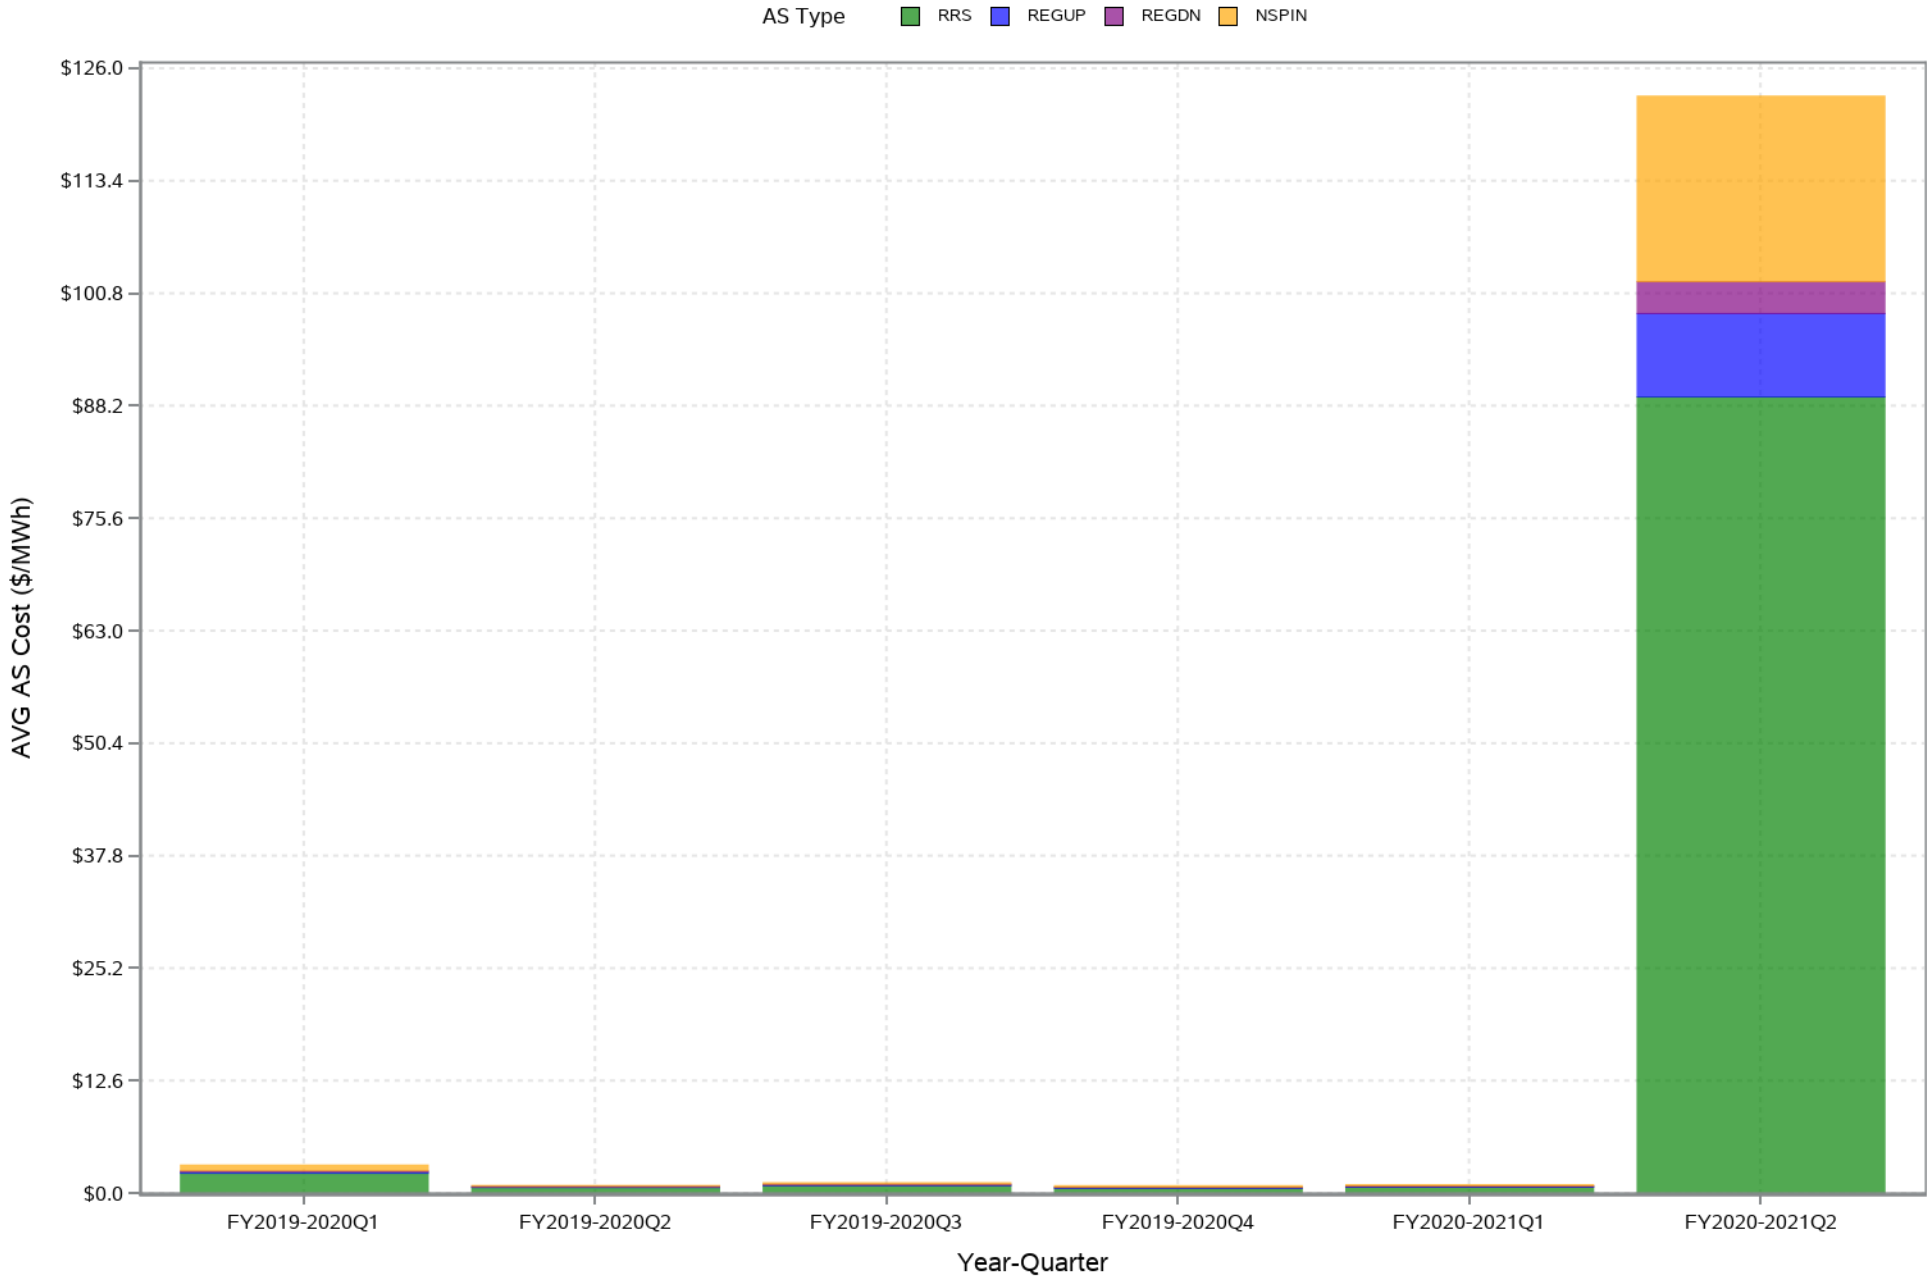

Quarterly Average DA vs. RT Load Forecast Error by Hour Ending

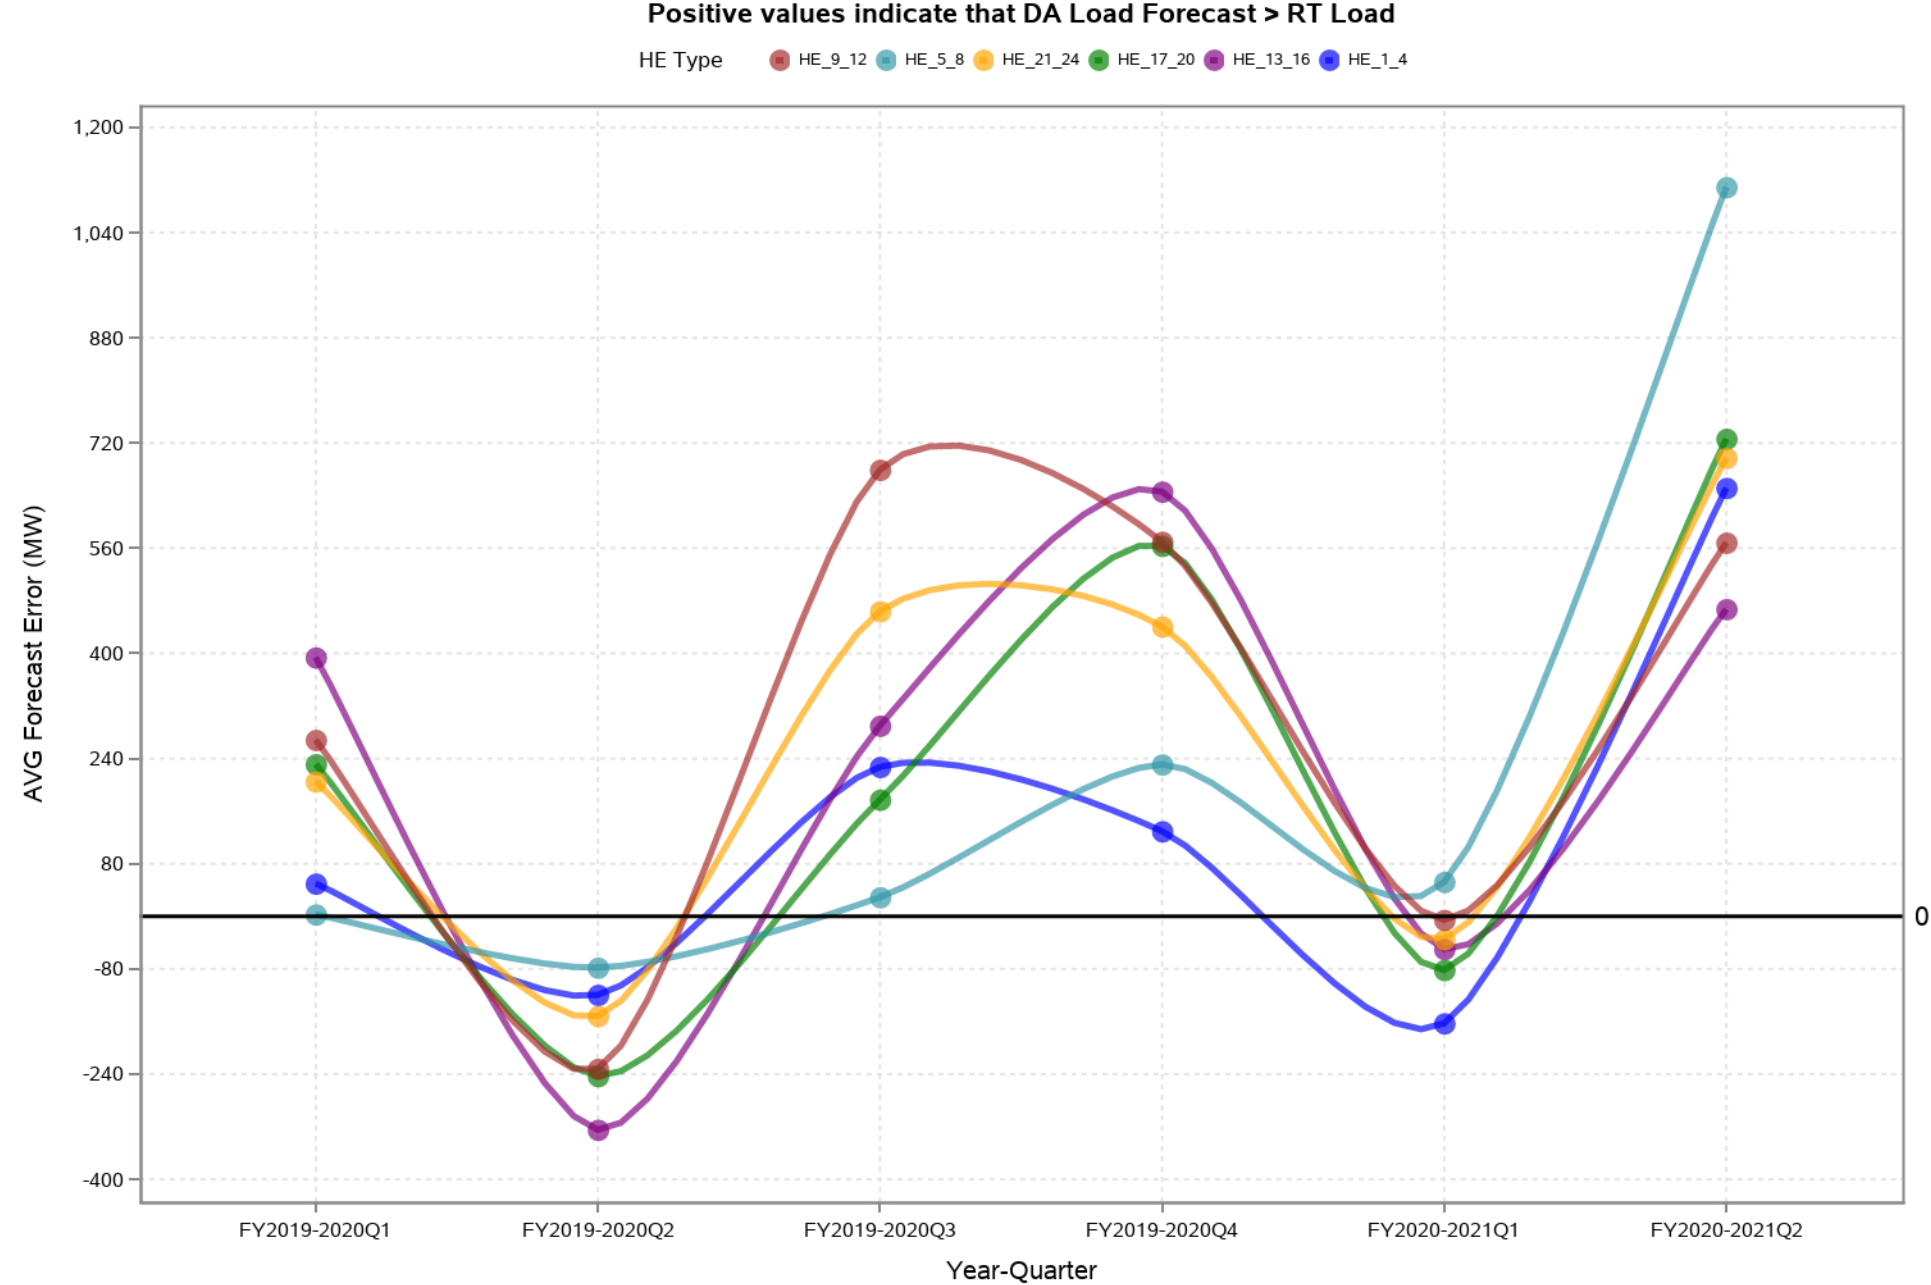



Quarterly Average of Wind Generation by Hour Ending

