



## Average Energy Prices DA vs. RT

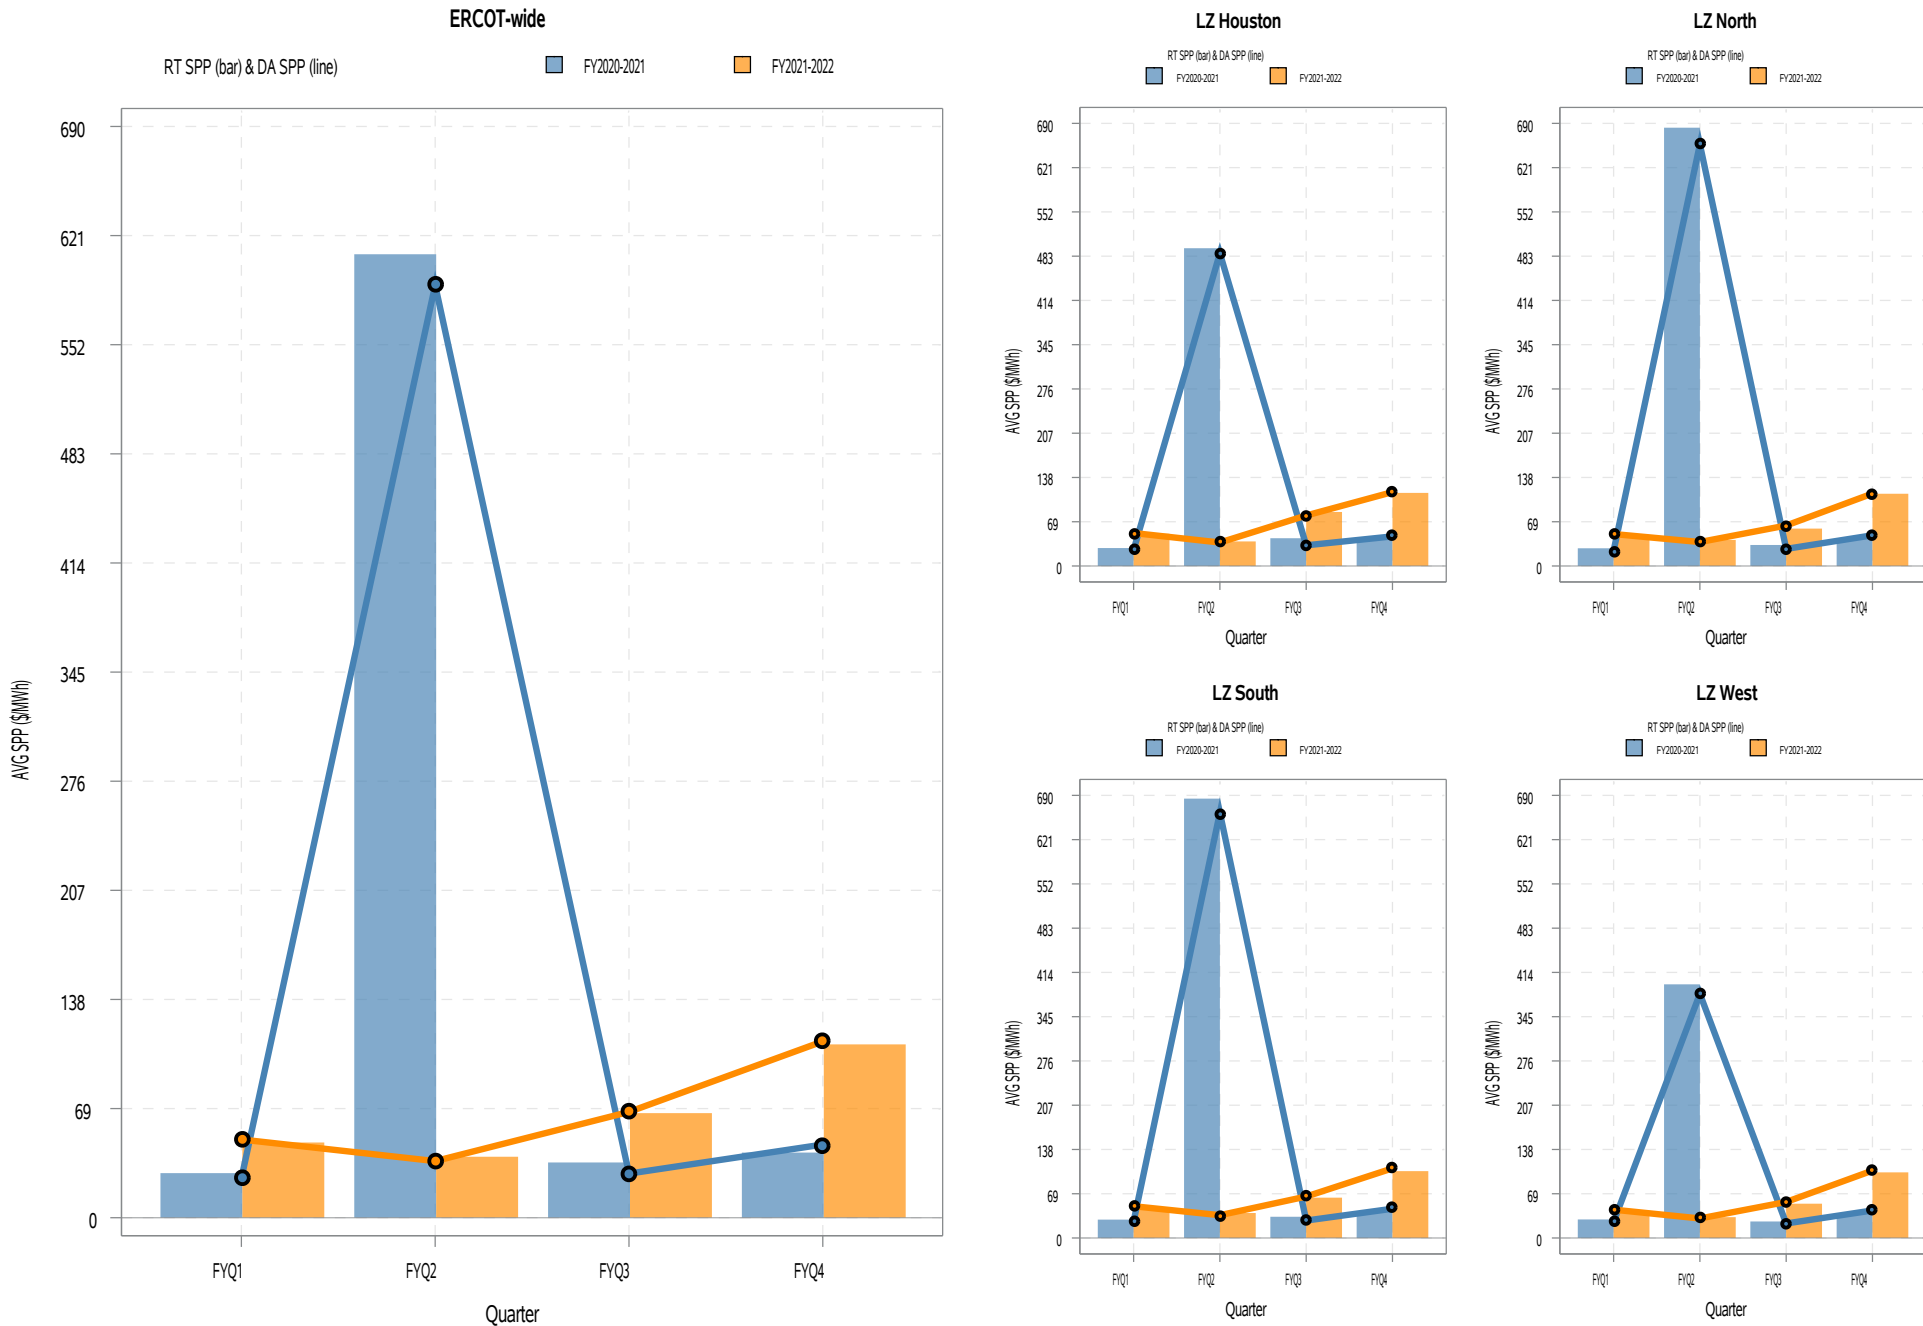


## Average Heat Rates DA vs. RT


ERCOT-wide

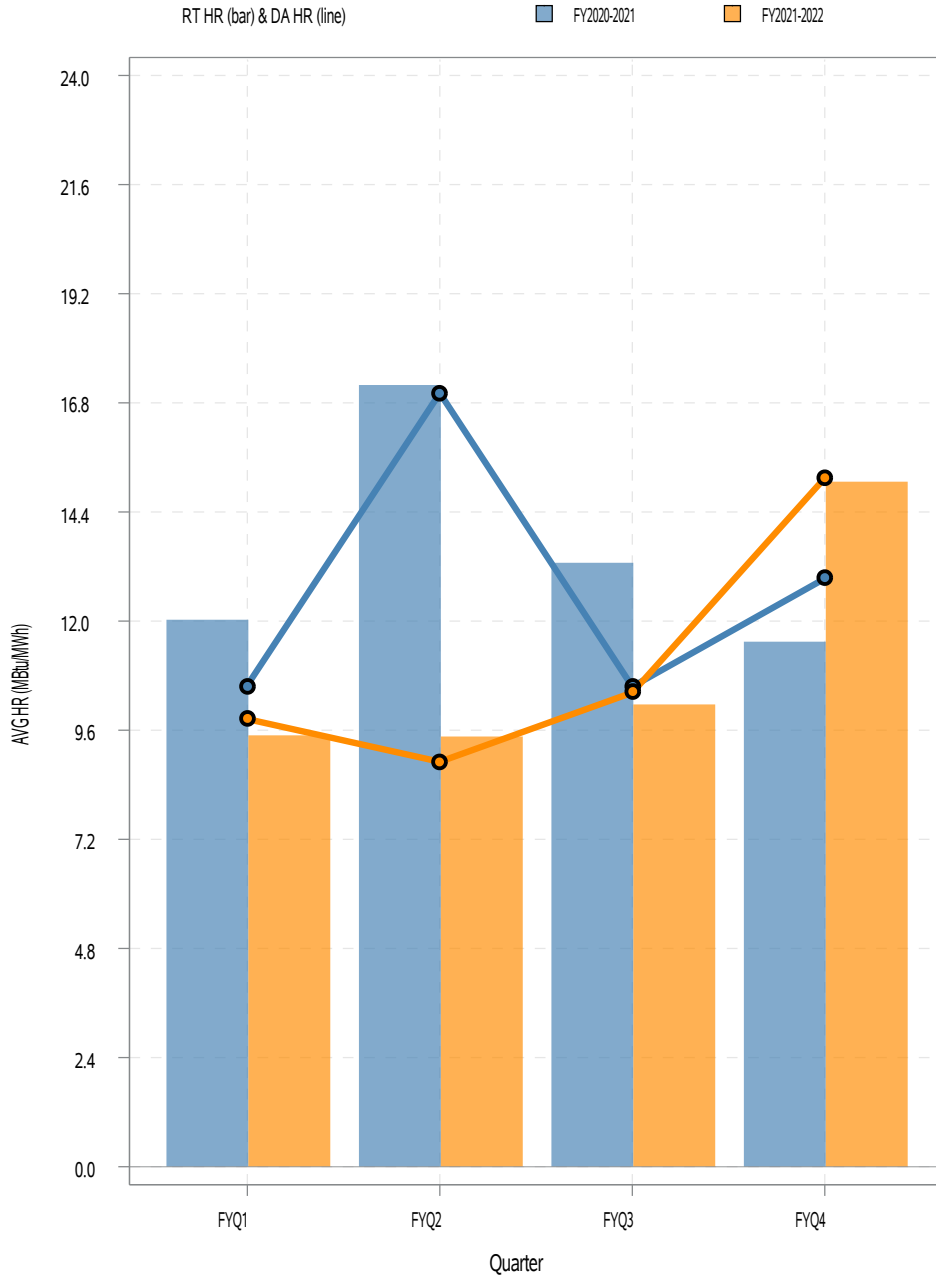


LZ Houston

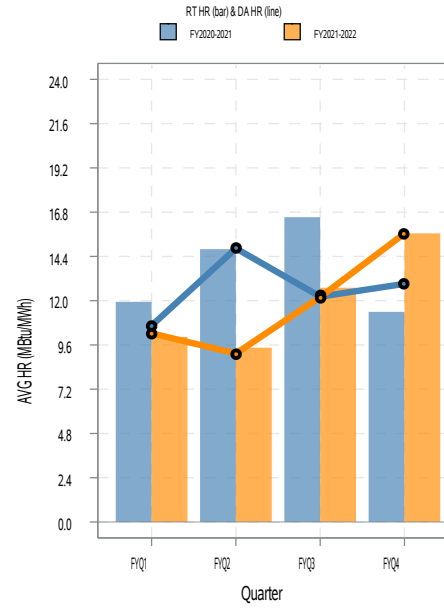


LZ North

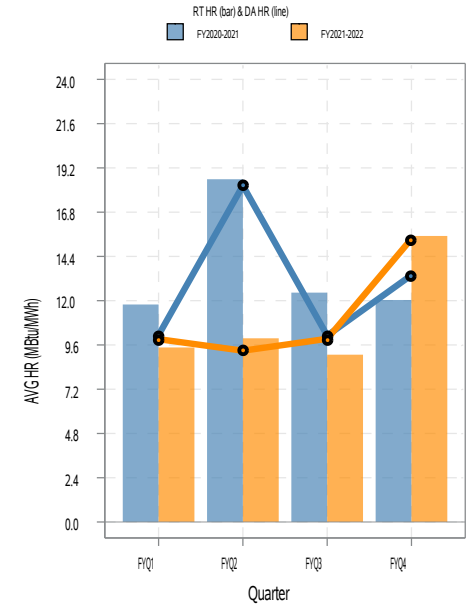





LZ South

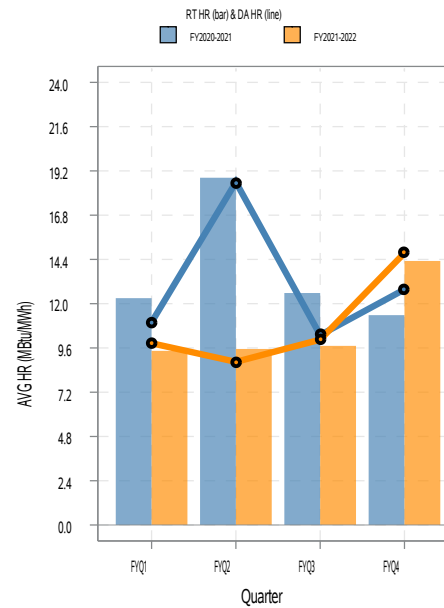



LZ West

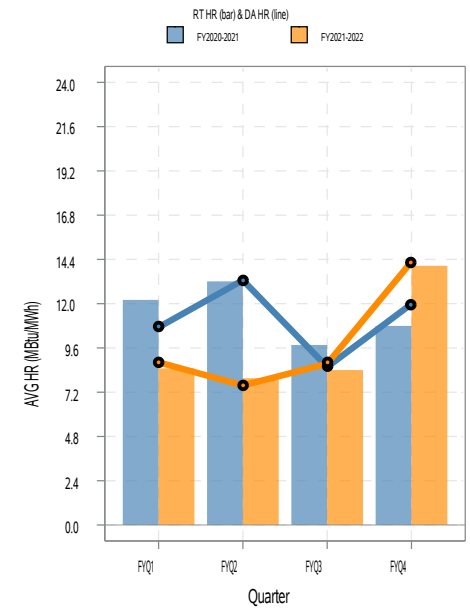





## Load Zone Loads Averages vs. Peaks

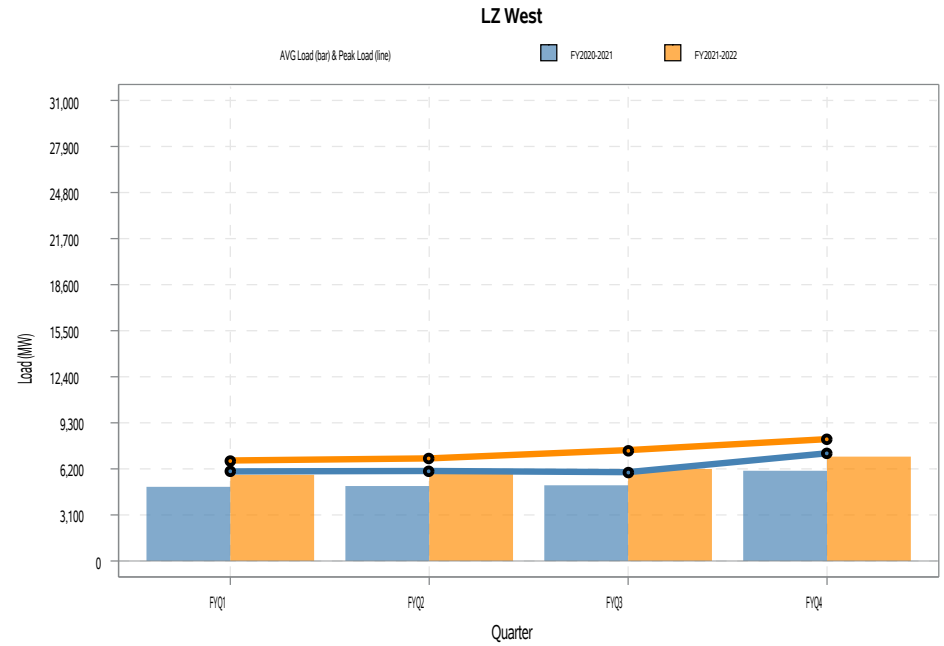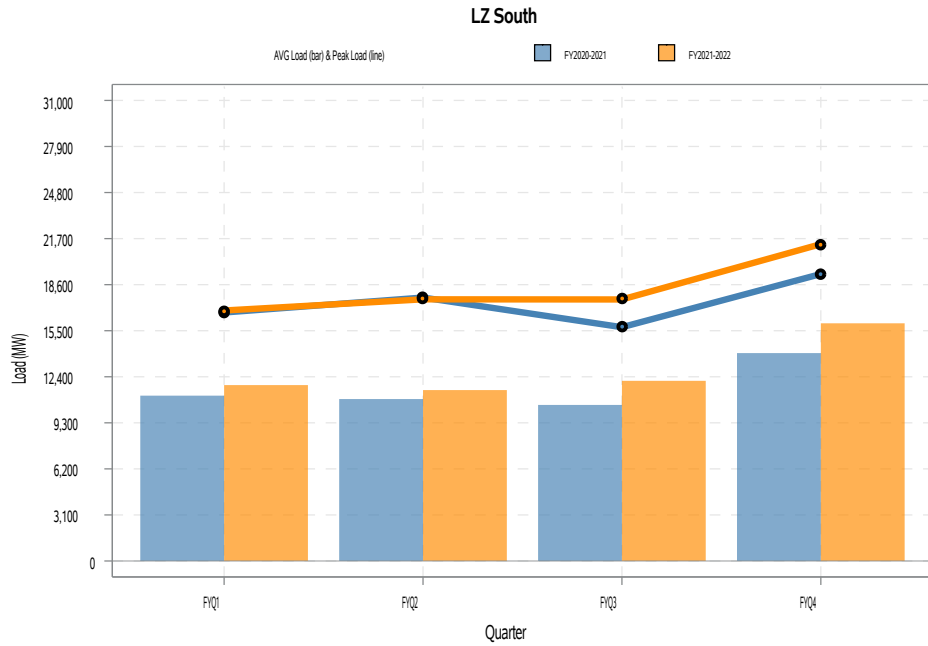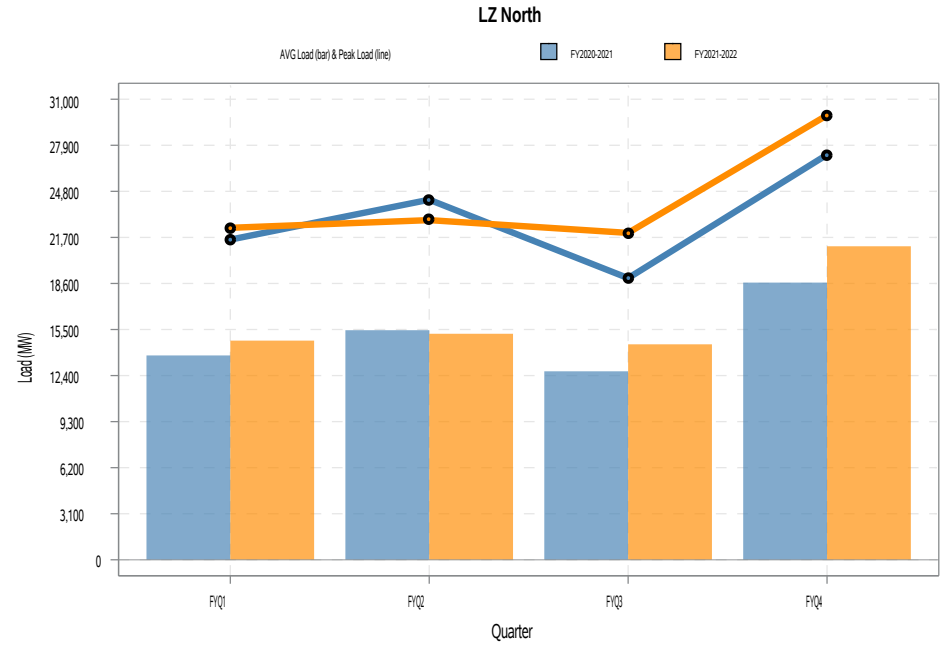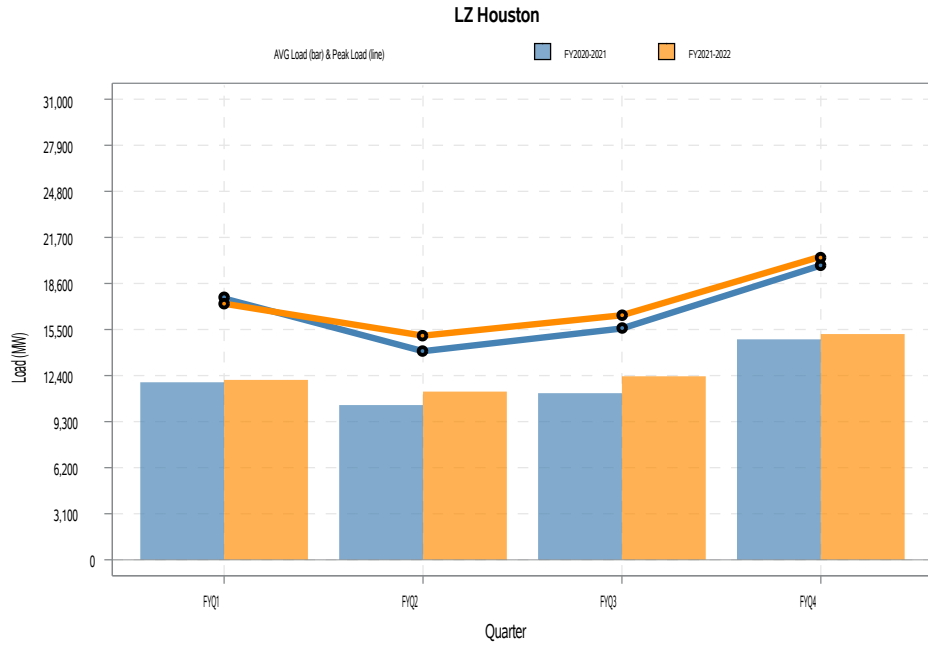





## Daily ORDC Reserve/Reliability Adders Average Values in FY2021-2022Q4

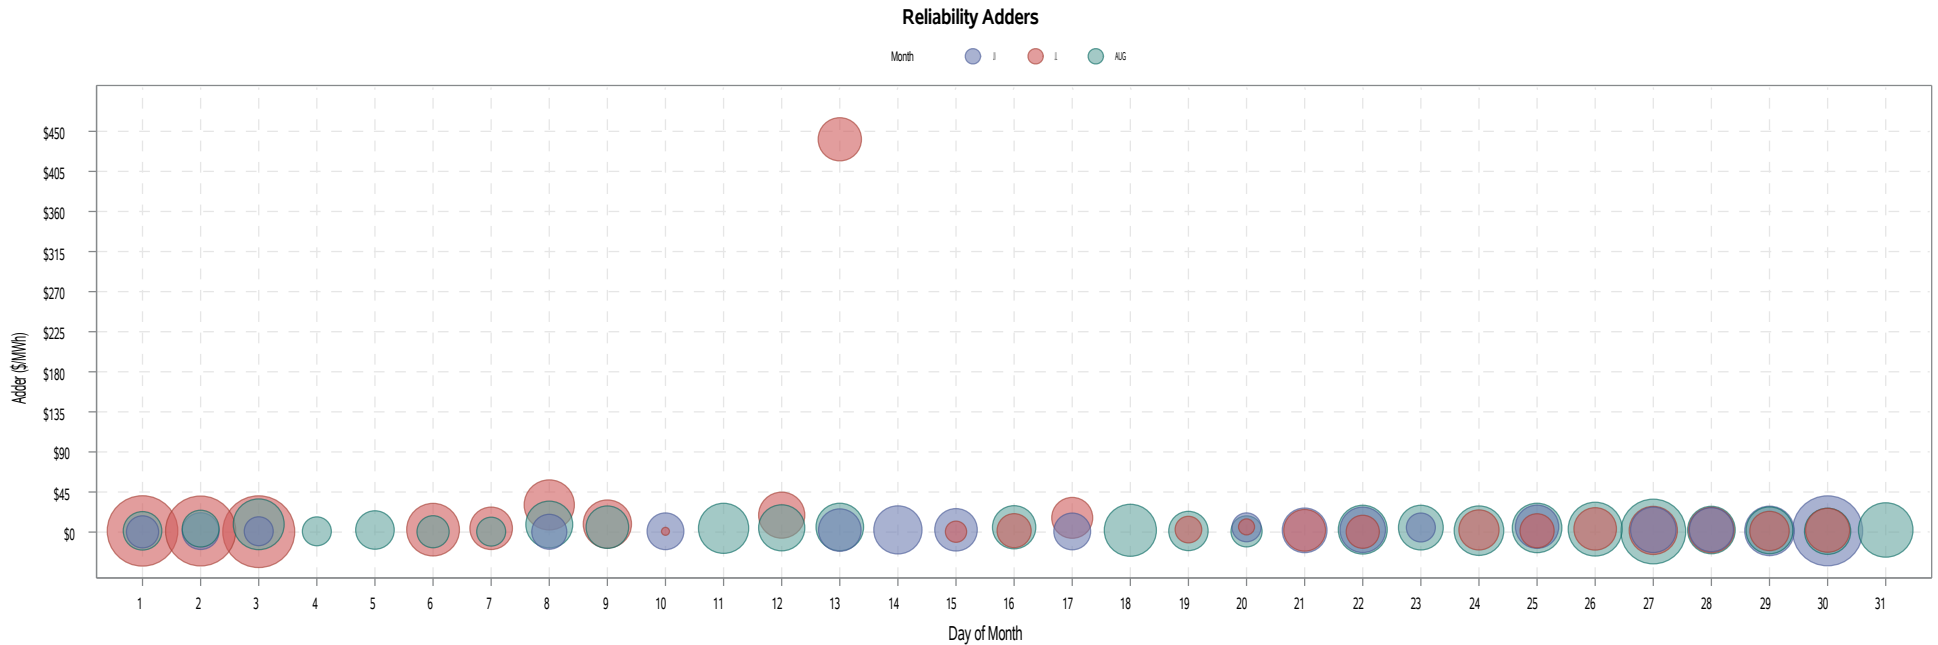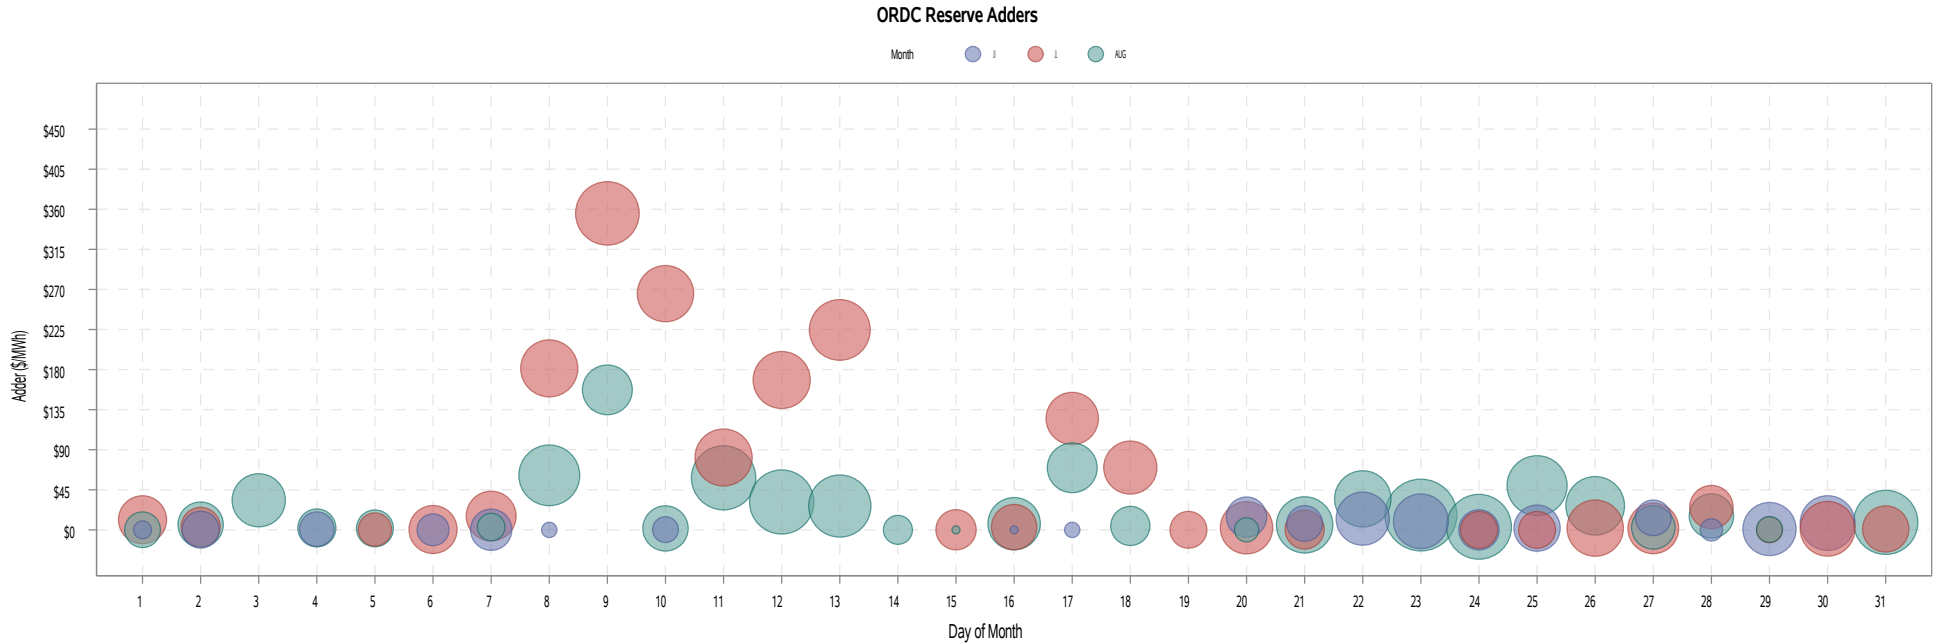


## Quarterly Average of Ancillary Services Required MW

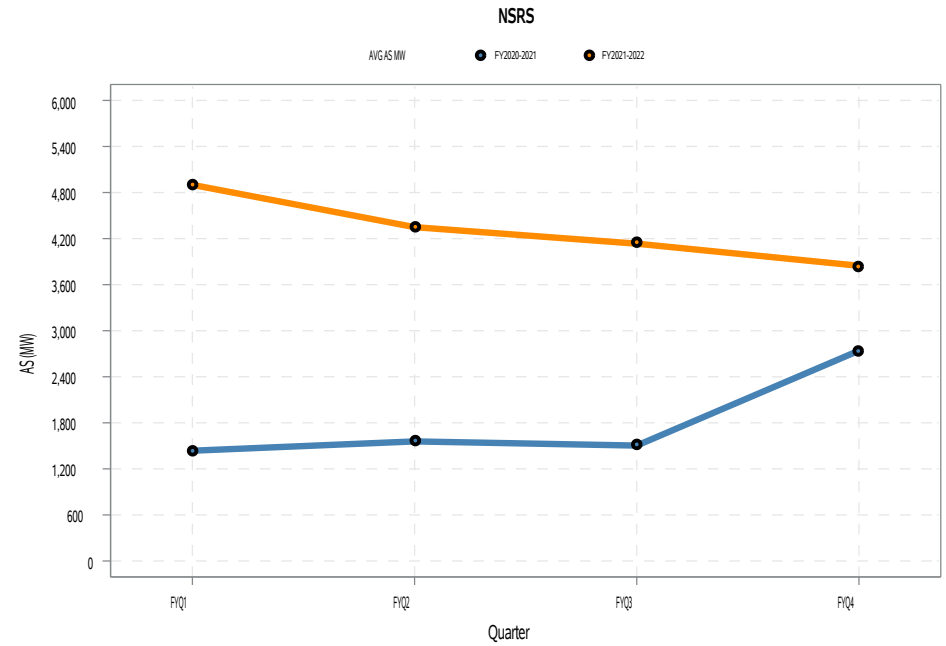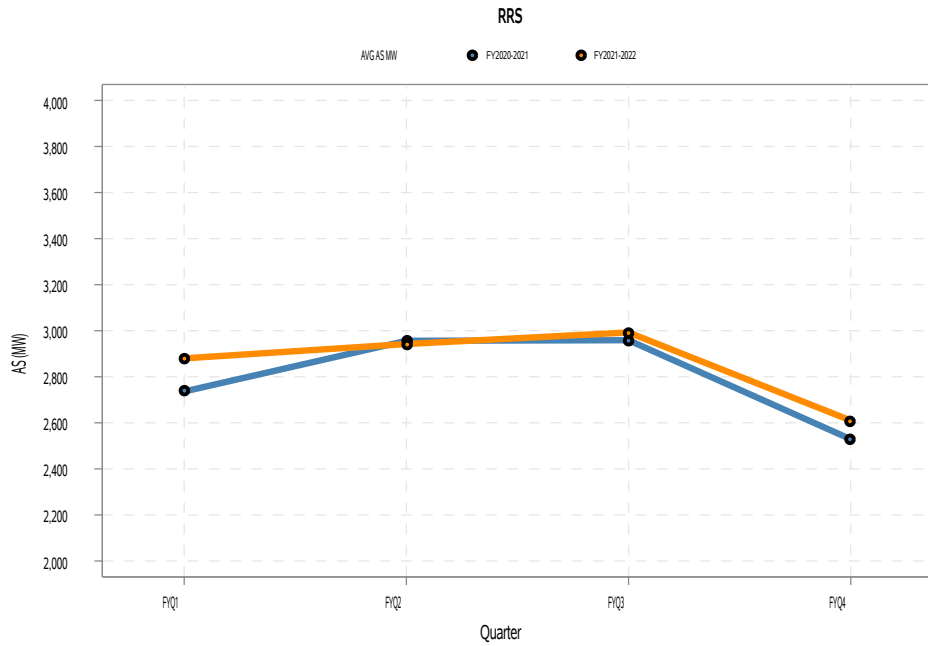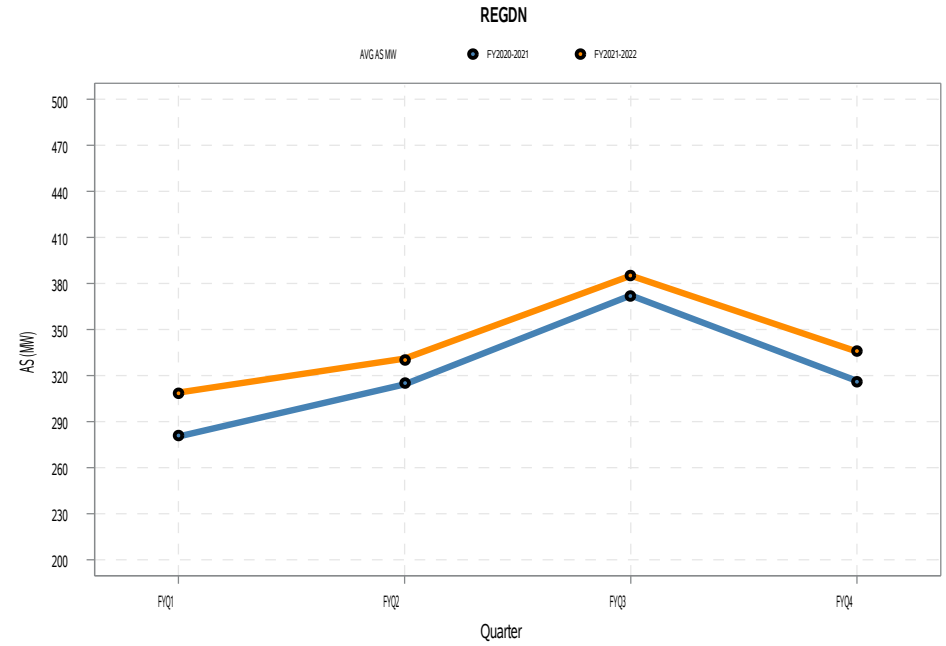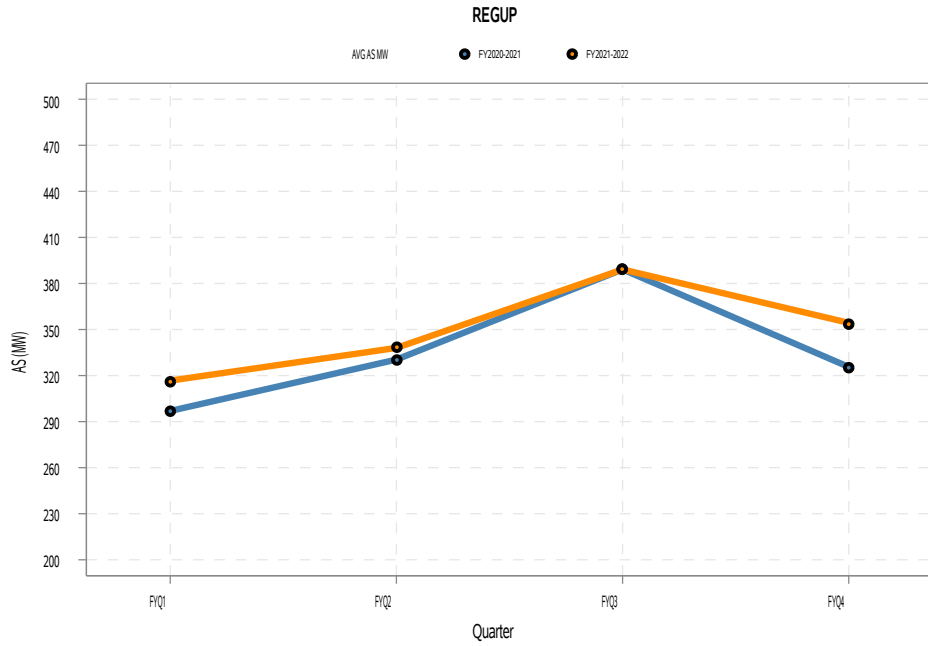

## Quarterly Average of Ancillary Services Prices (MCPCs)

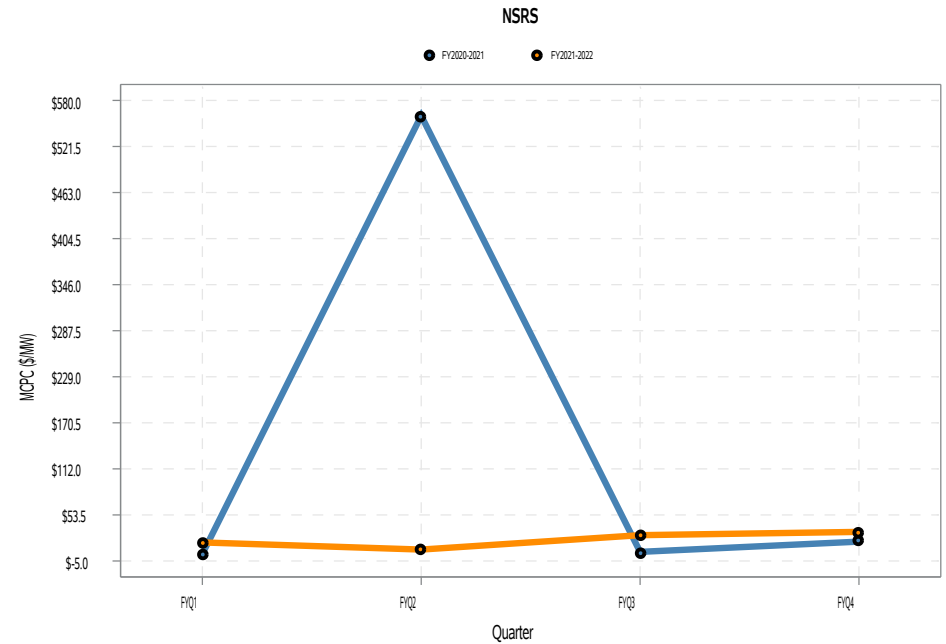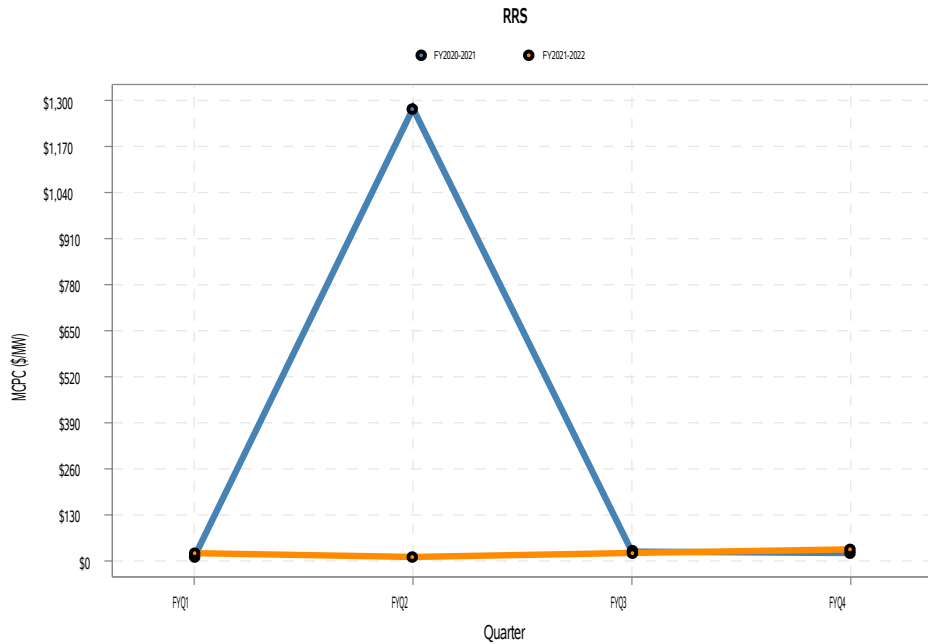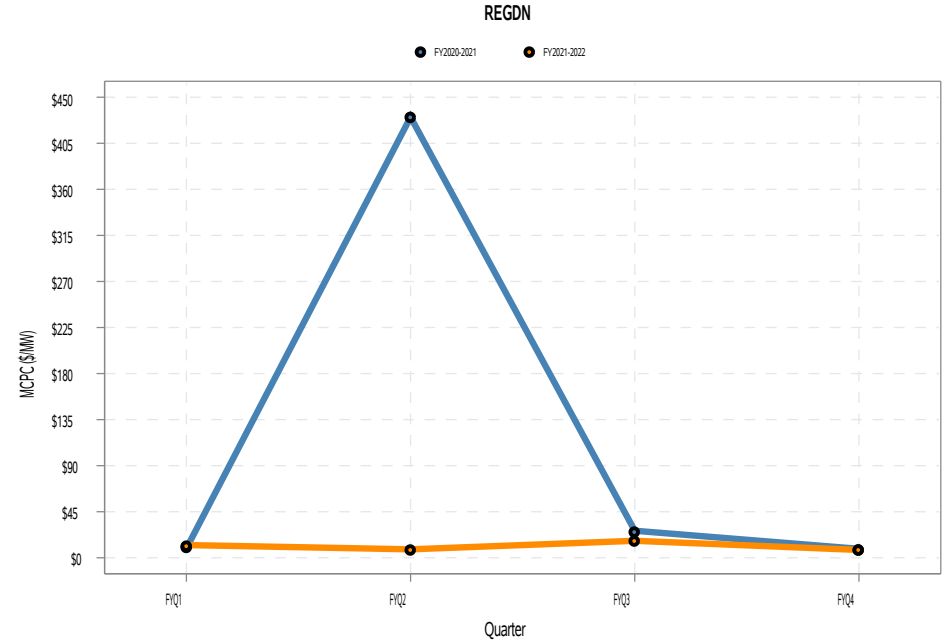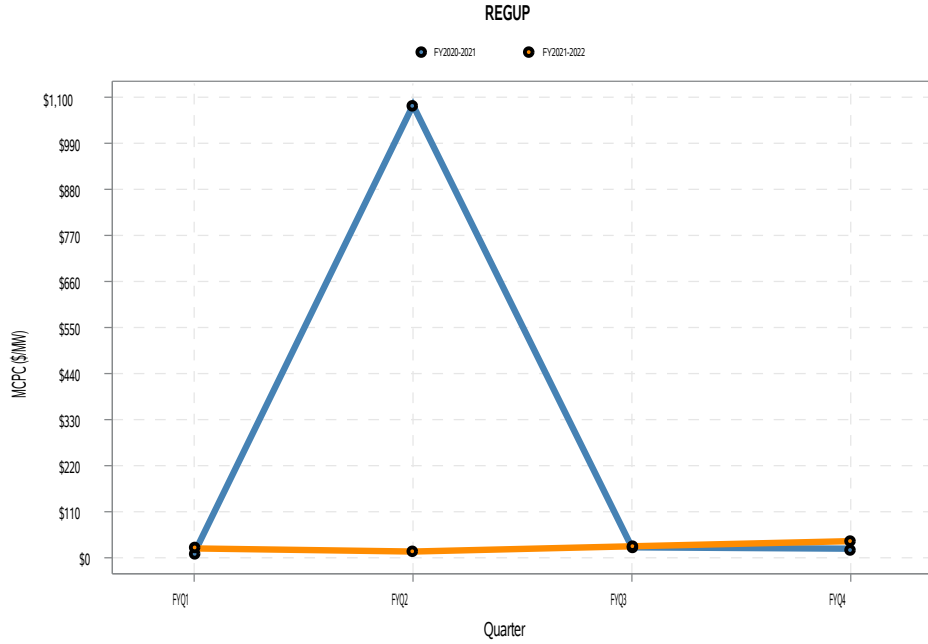


## Quarterly Average Ancillary Services Cost per MWh Load

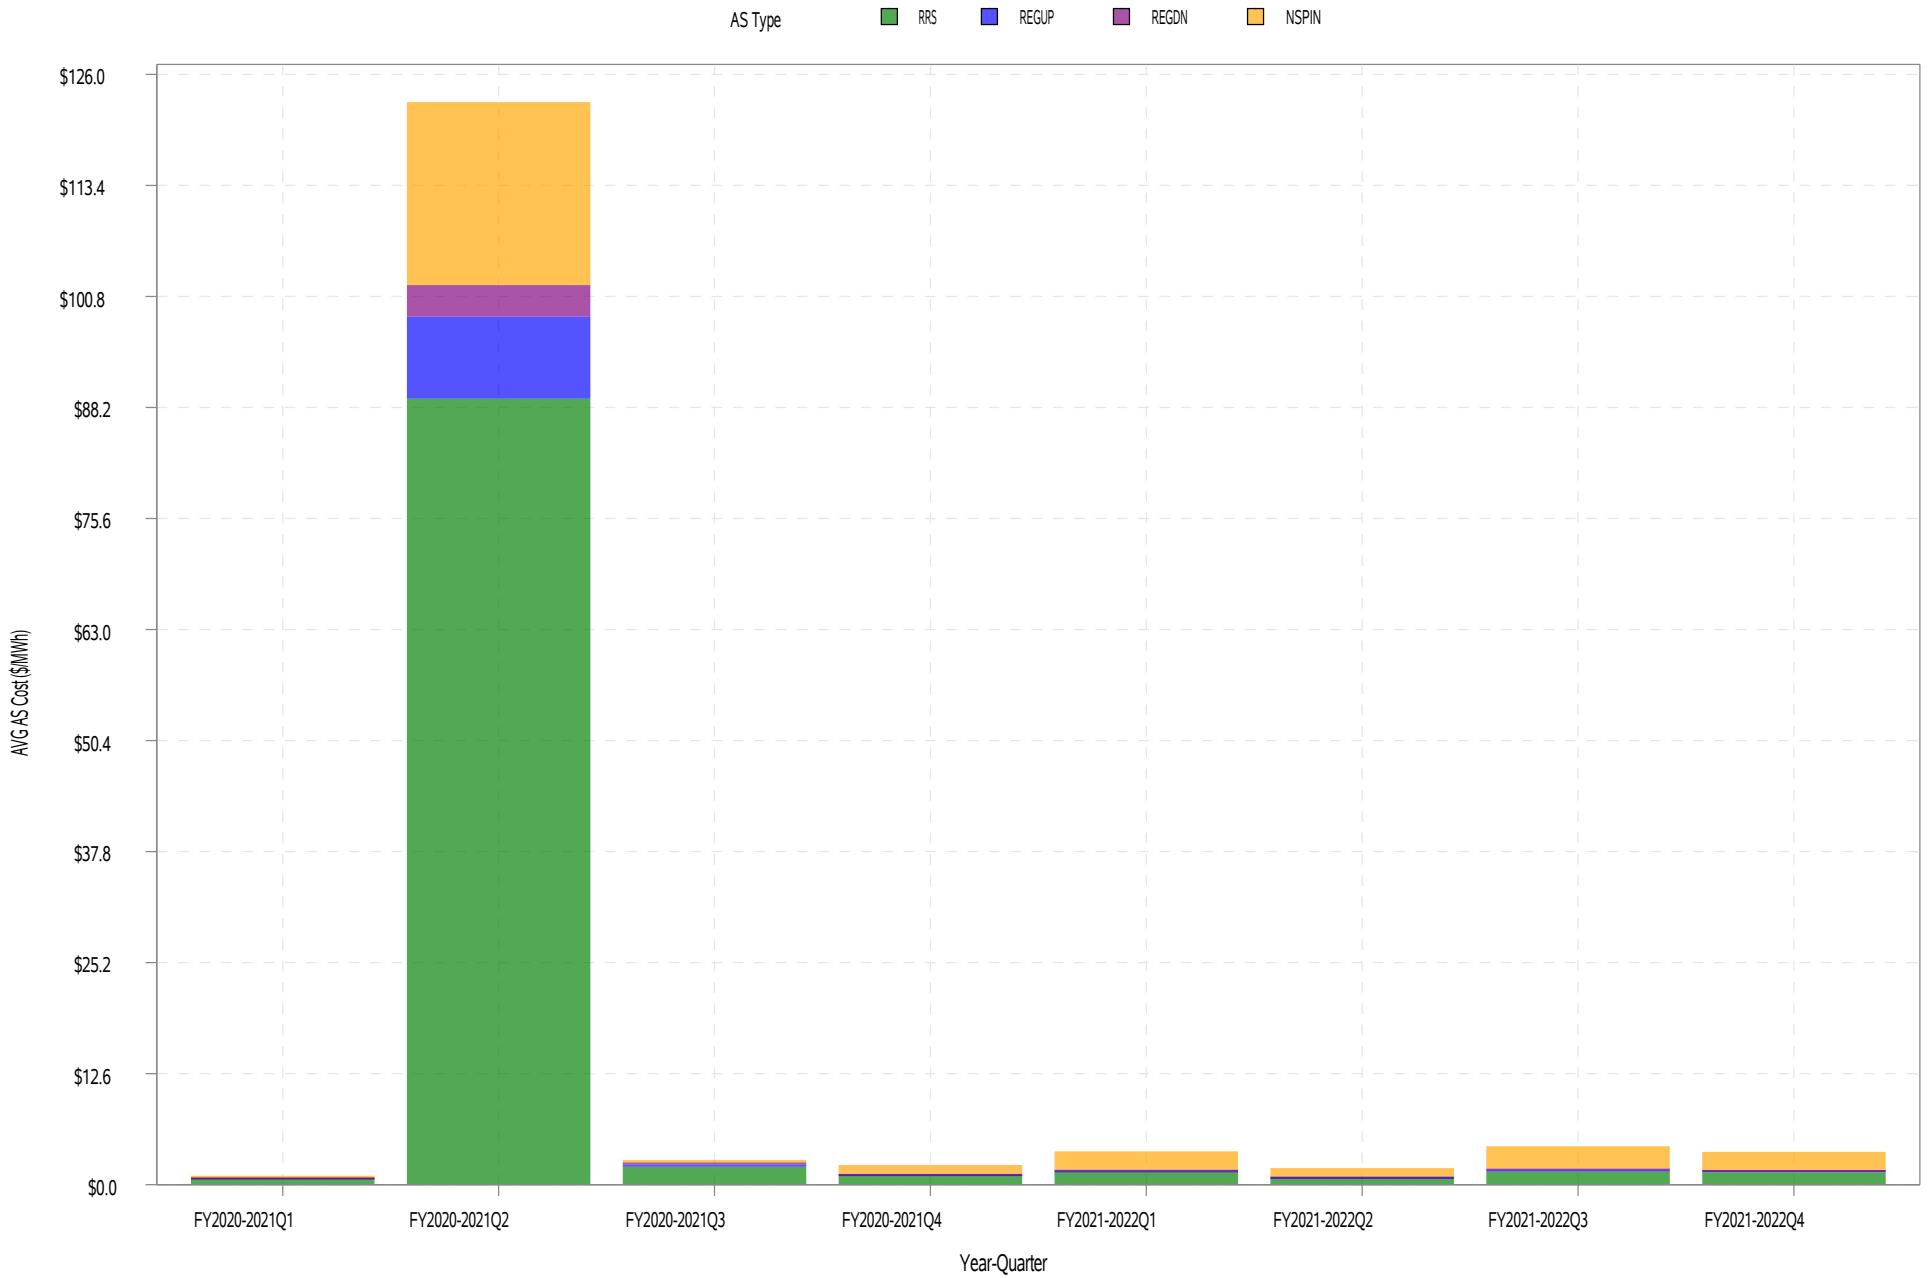

## Quarterly Average DA vs. RT Load Forecast Error by Hour Ending

Positive values indicate that DA Load Forecast > RT Load

HE Type      ● HE\_9\_12      ● HE\_5\_8      ● HE\_21\_24      ● HE\_17\_20      ● HE\_13\_16      ● HE\_1\_4

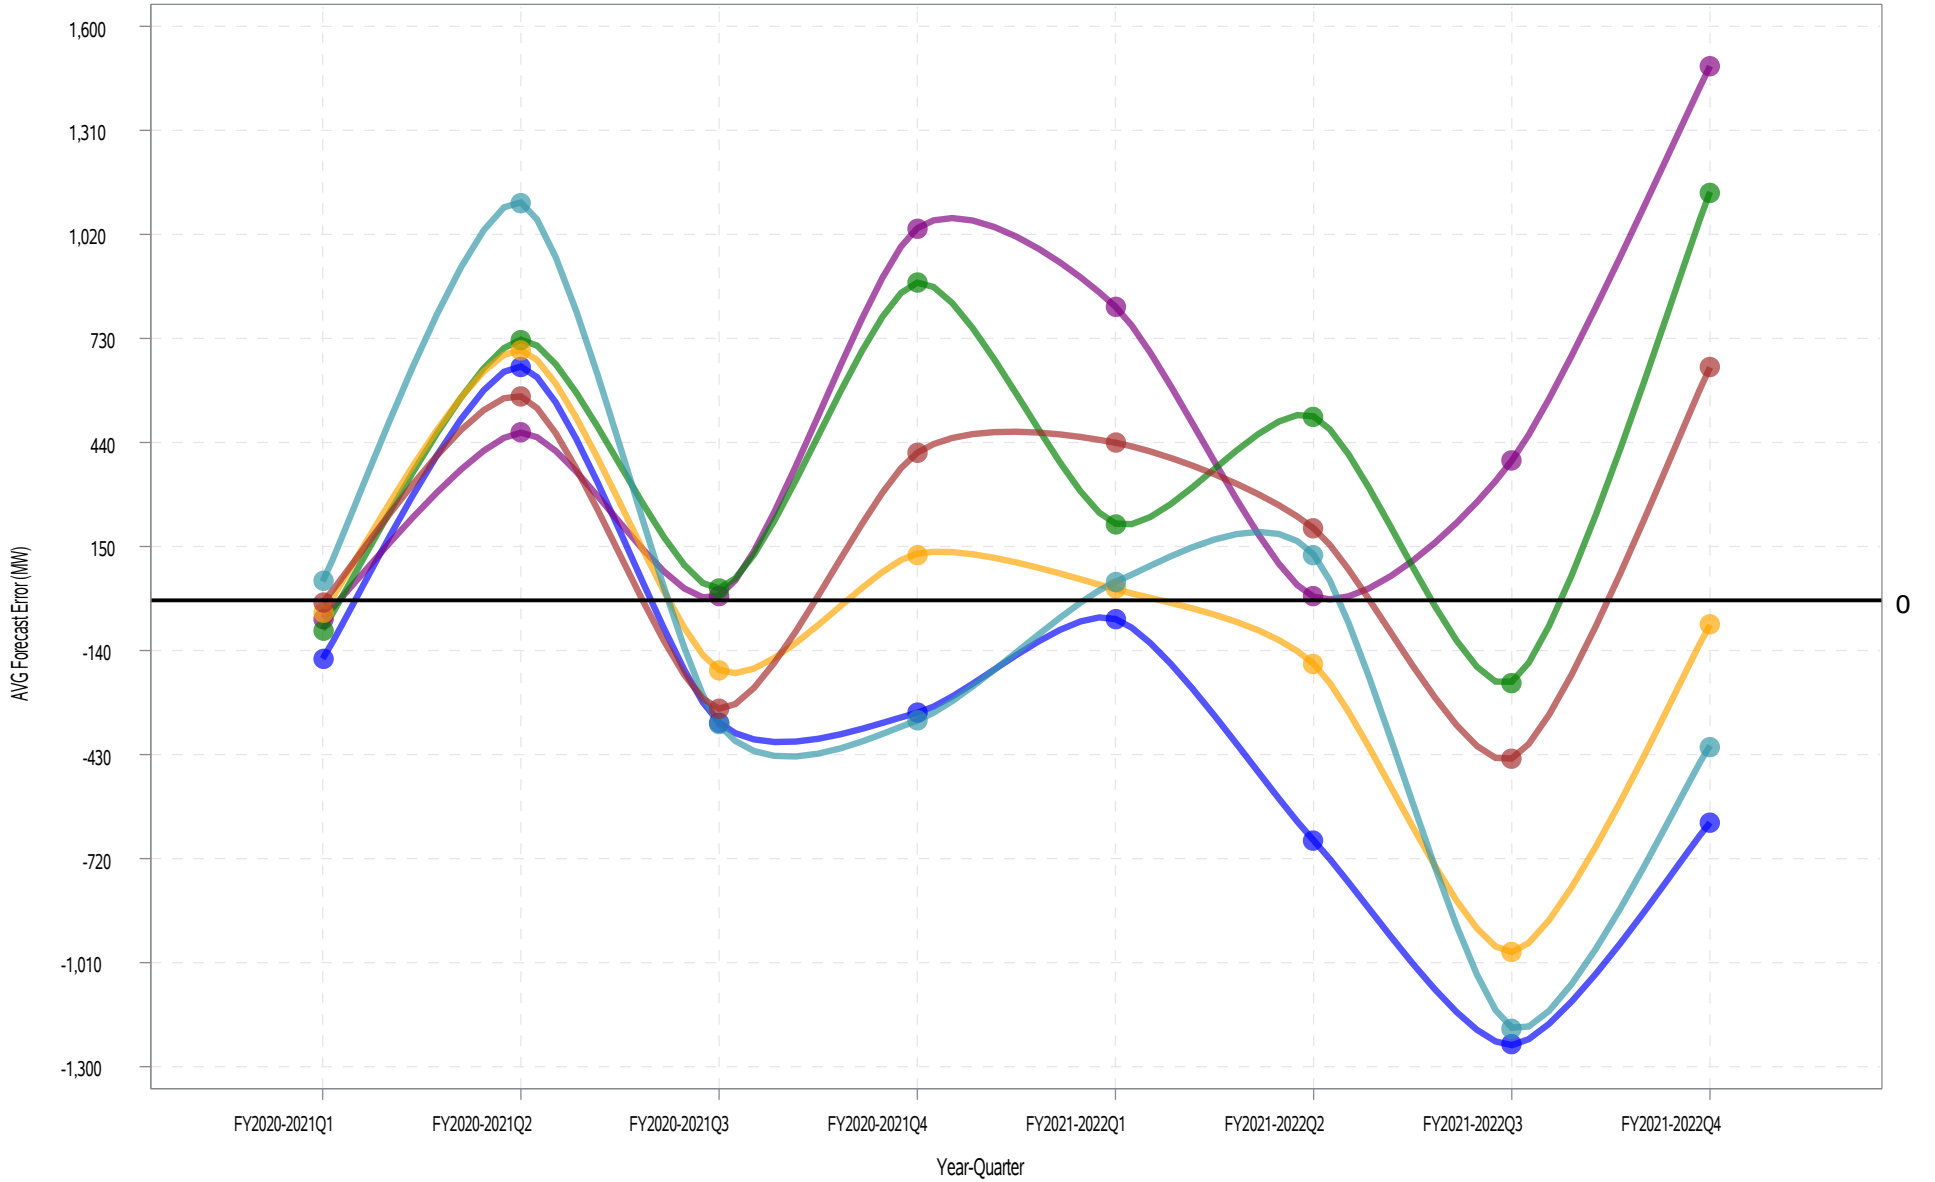



## Quarterly Average of Wind Generation by Hour Ending

