


Average Energy Prices DA vs. RT

ERCOT-wide

RT SPP (bar) & DA SPP (line)

FY2021-2022

FY2022-2023

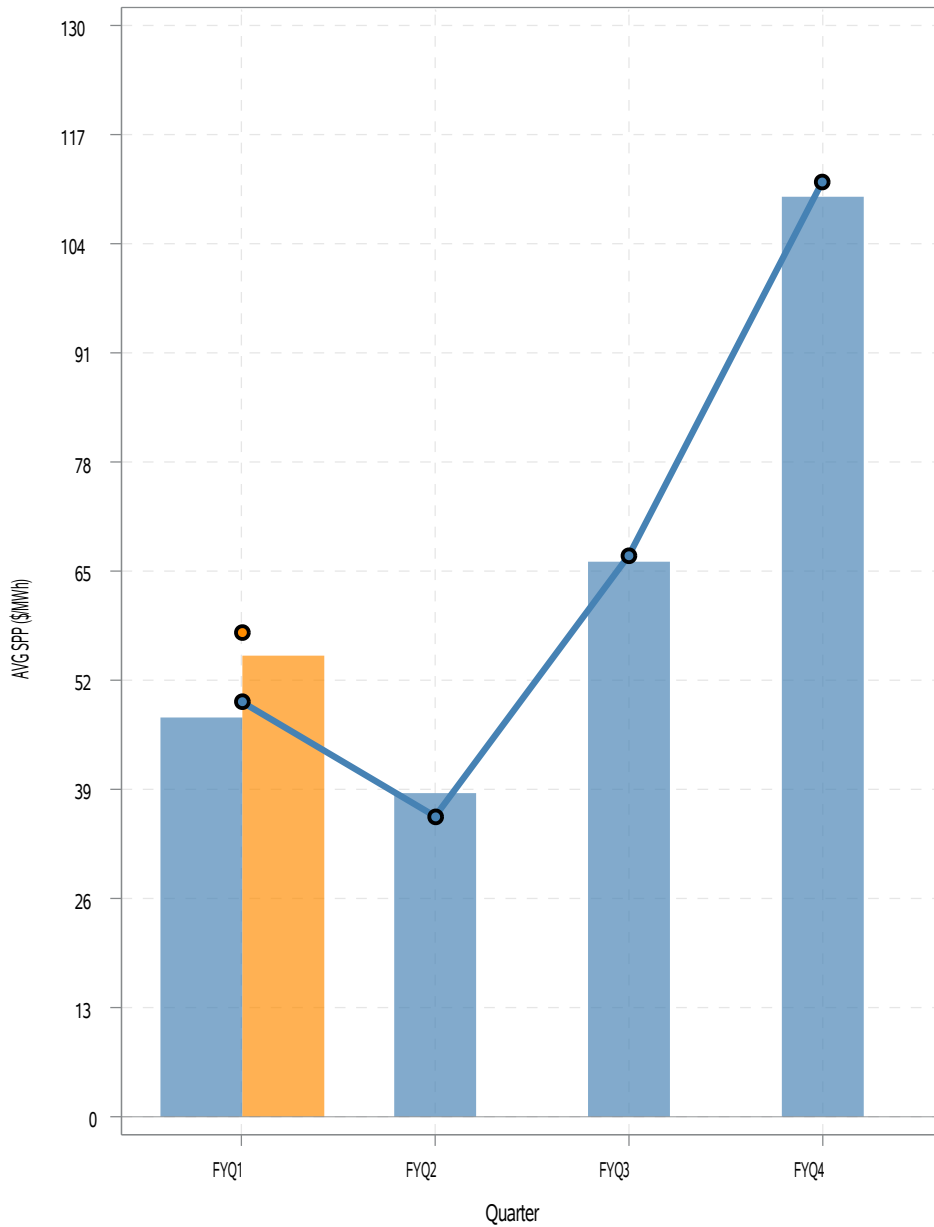


LZ Houston

RT SPP (bar) & DA SPP (line)

FY2021-2022

FY2022-2023

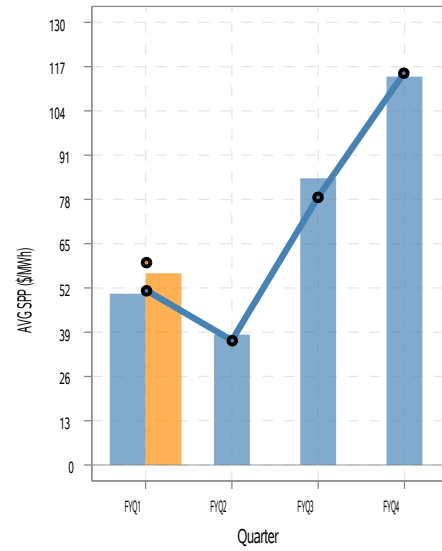


LZ North

RT SPP (bar) & DA SPP (line)

FY2021-2022

FY2022-2023

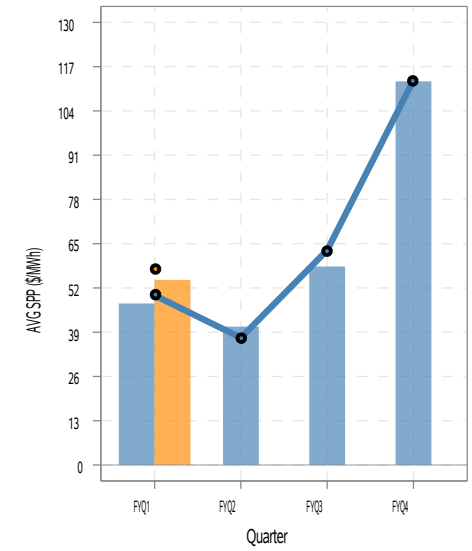


LZ South

RT SPP (bar) & DA SPP (line)

FY2021-2022

FY2022-2023

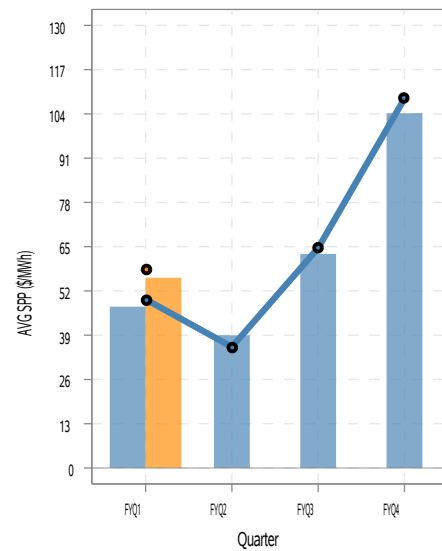


LZ West

RT SPP (bar) & DA SPP (line)


FY2021-2022

FY2022-2023

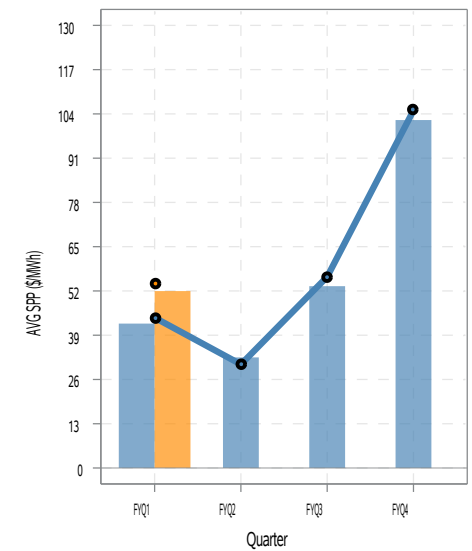


Average Heat Rates DA vs. RT


ERCOT-wide

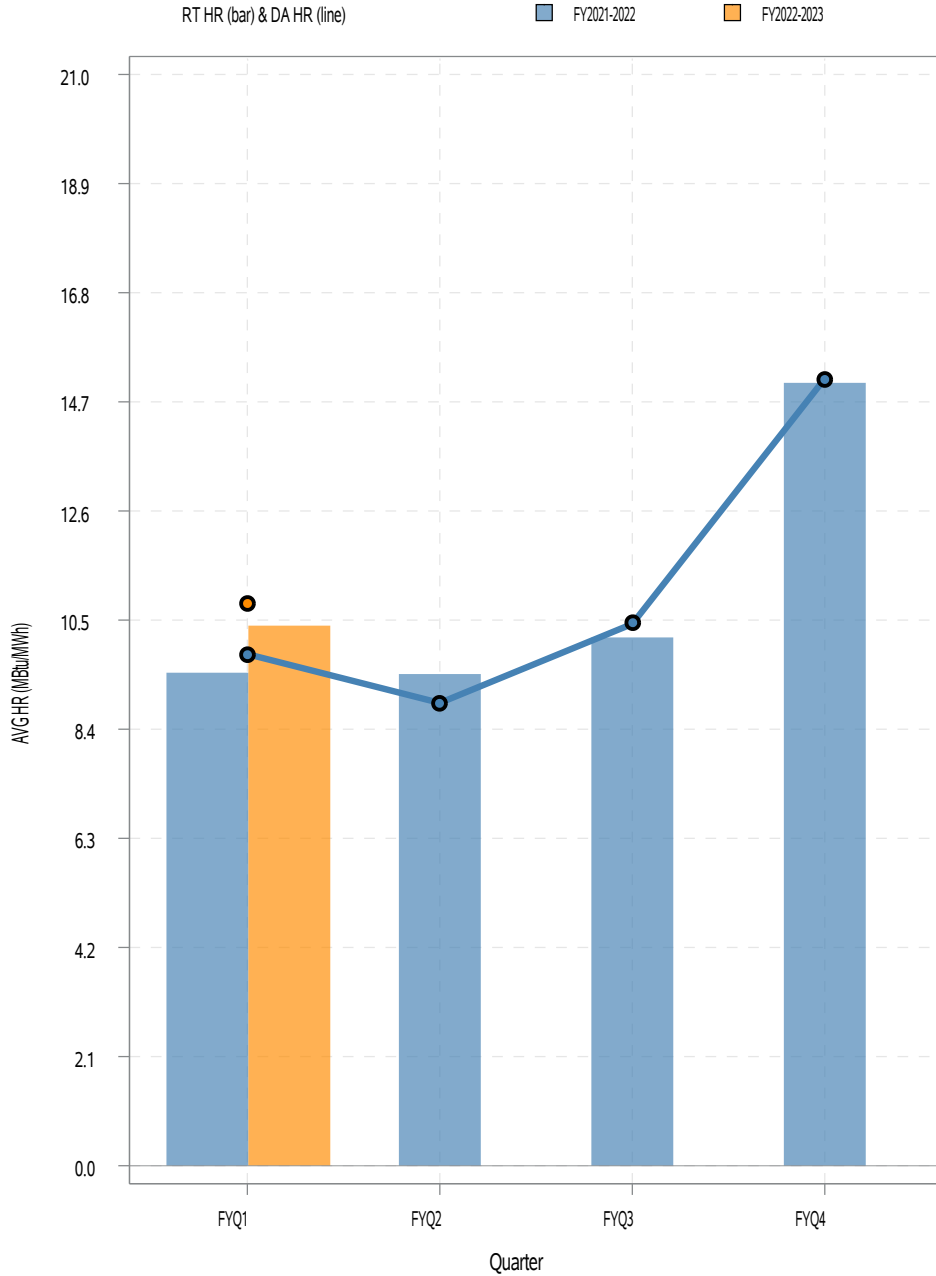


LZ Houston

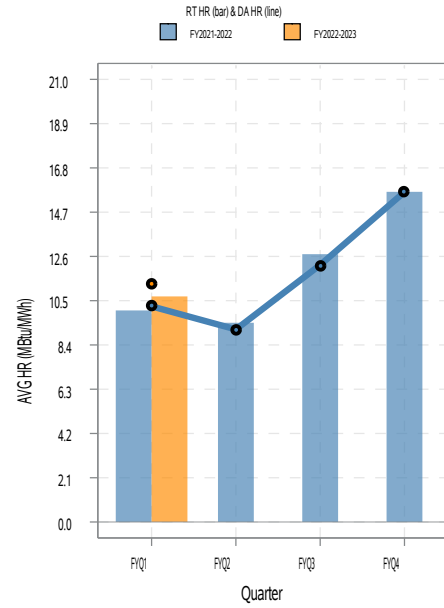


LZ North

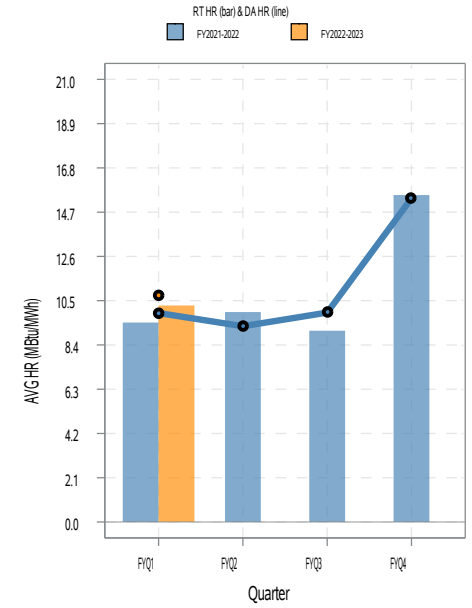





LZ South

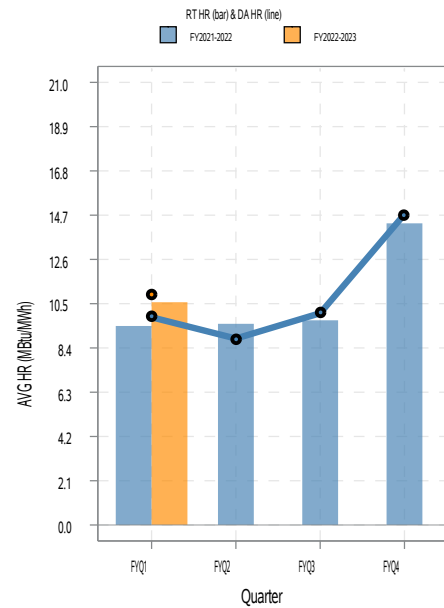



LZ West

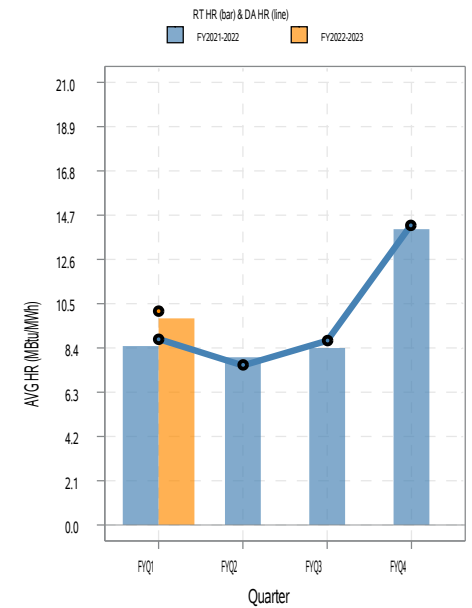





Load Zone Loads Averages vs. Peaks

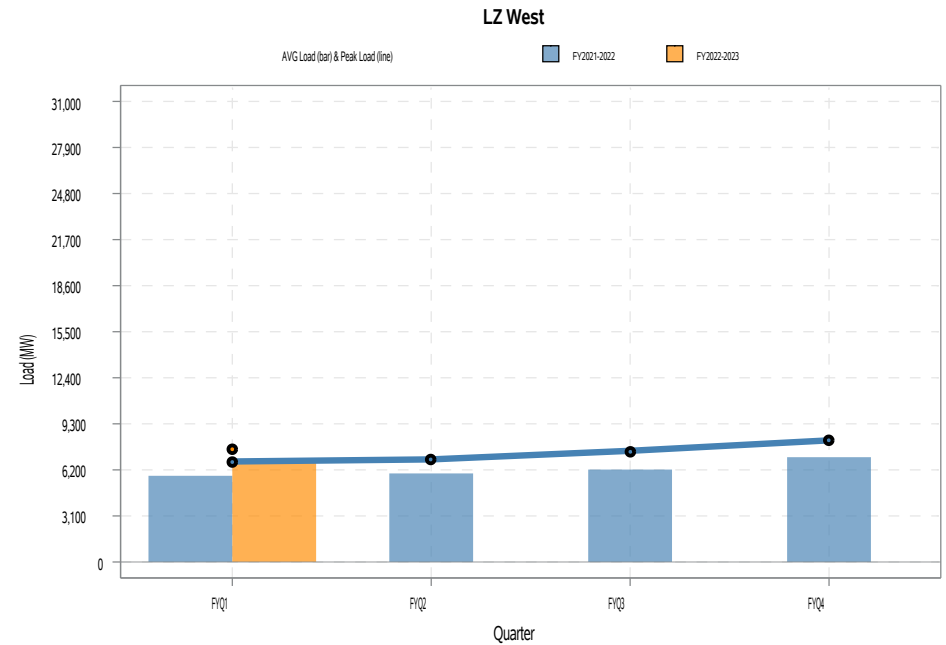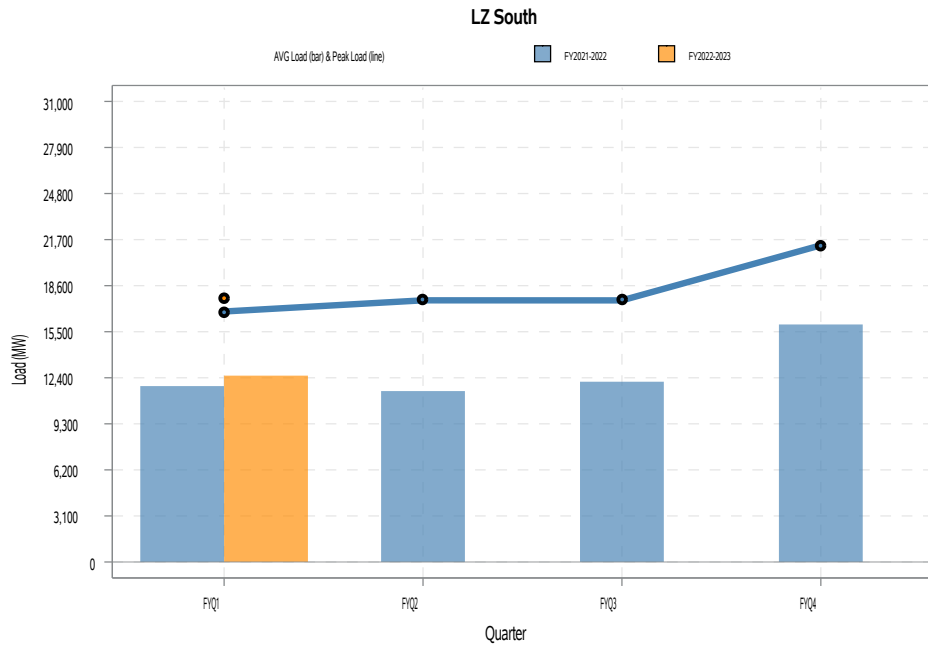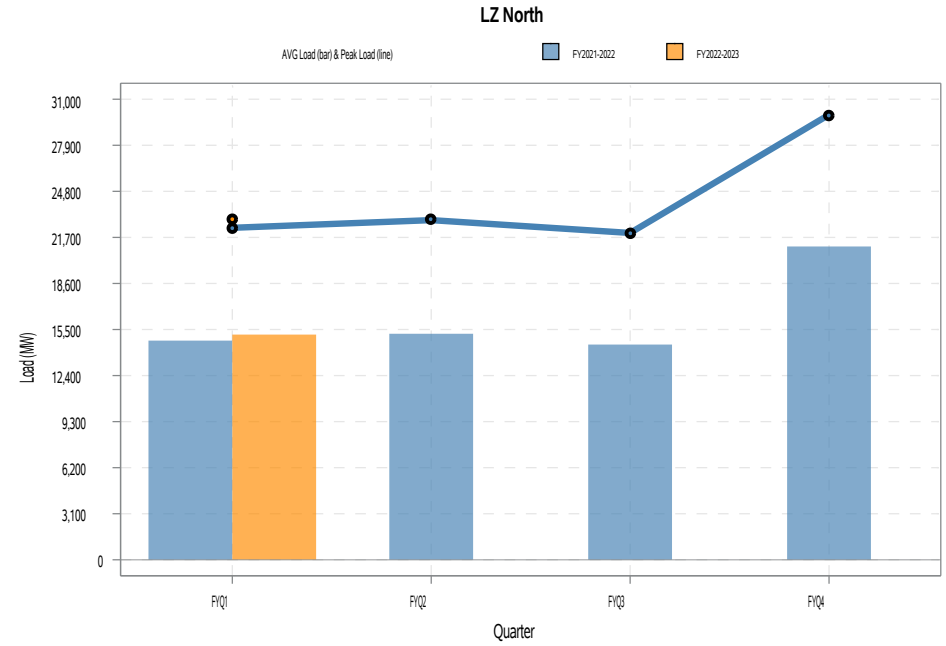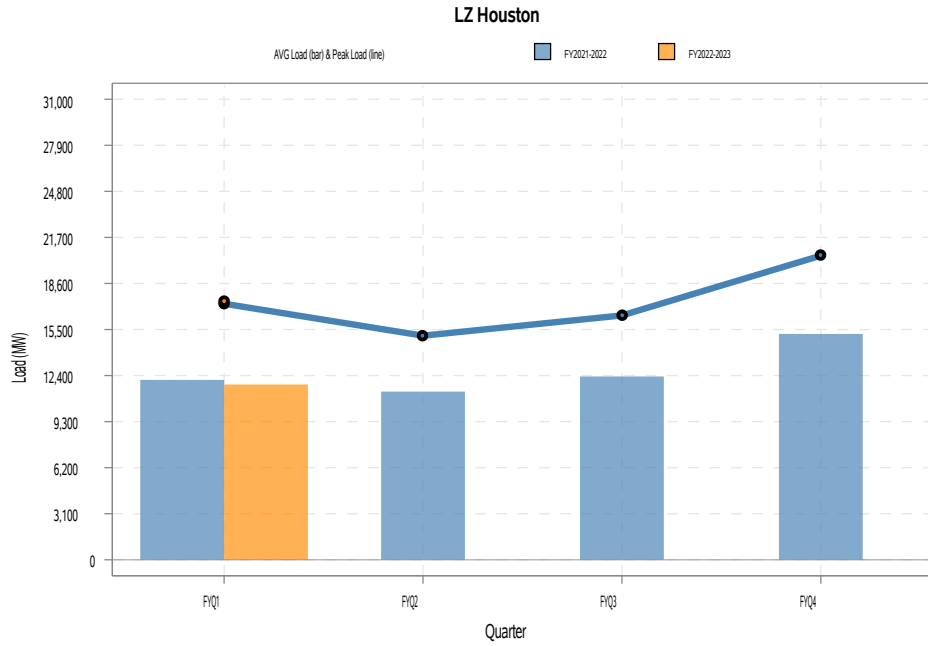





Daily ORDC Reserve/Reliability Adders Average Values in FY2022-2023Q1

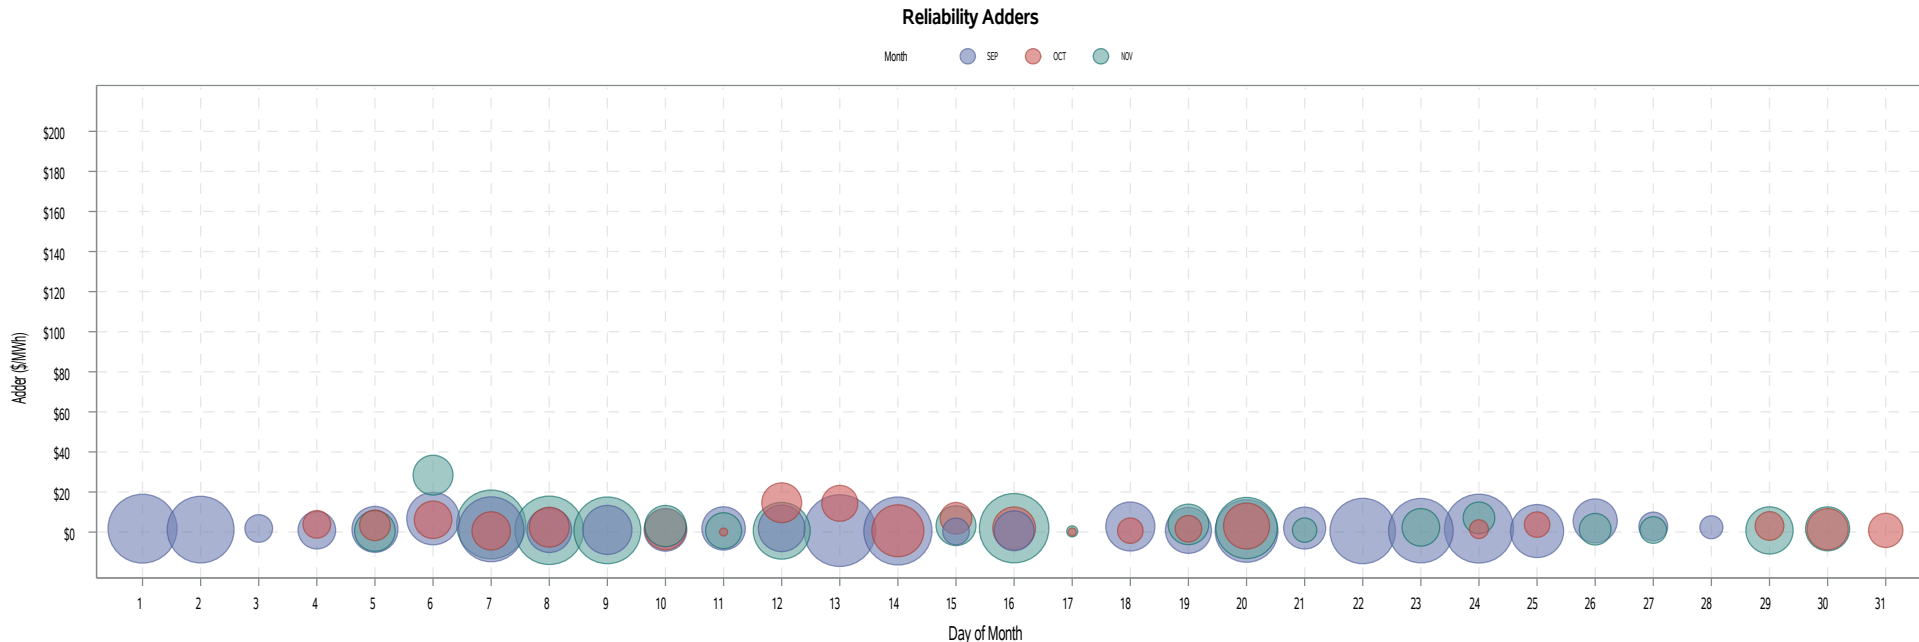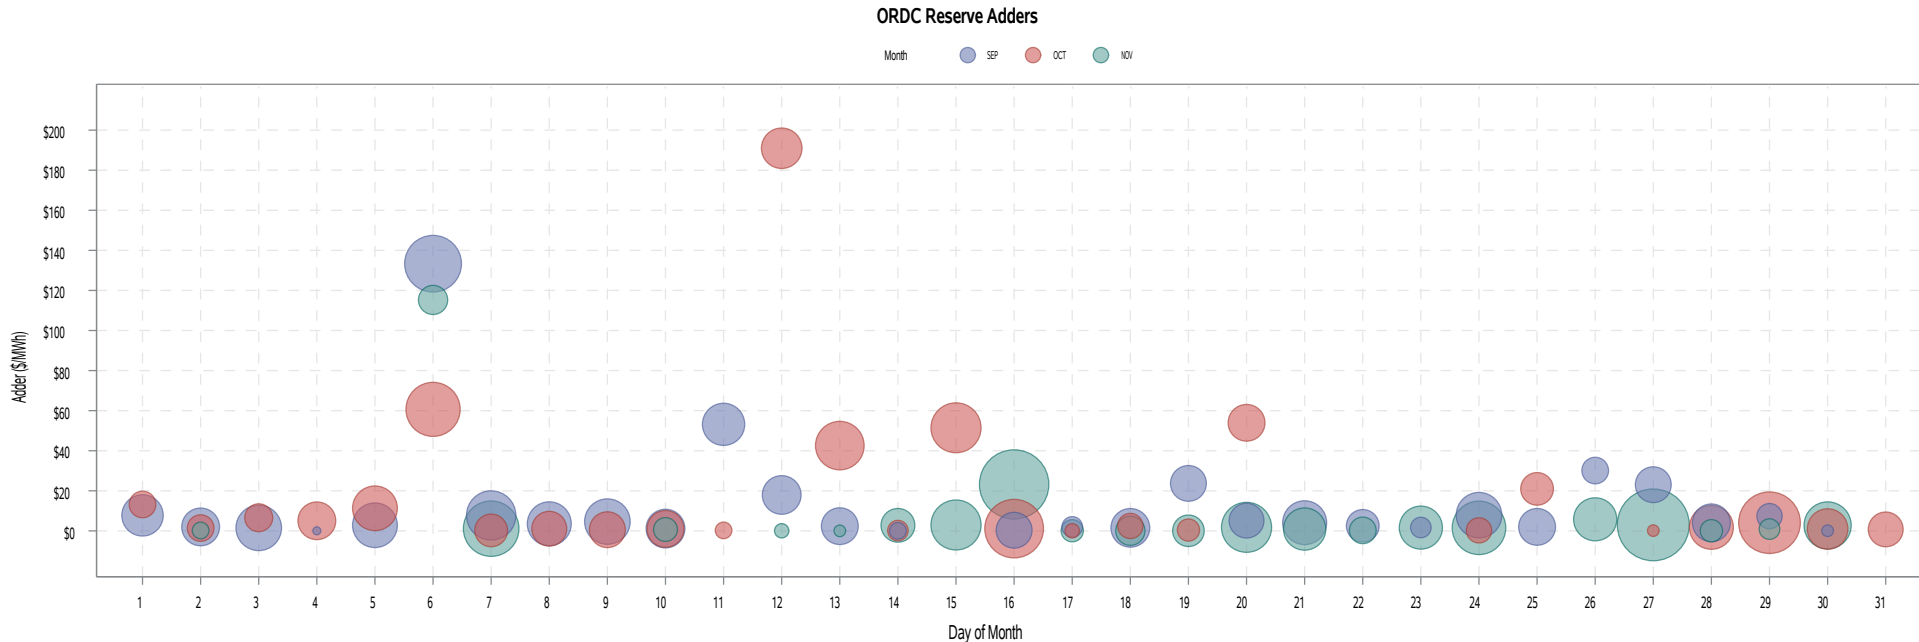


Quarterly Average of Ancillary Services Required MW

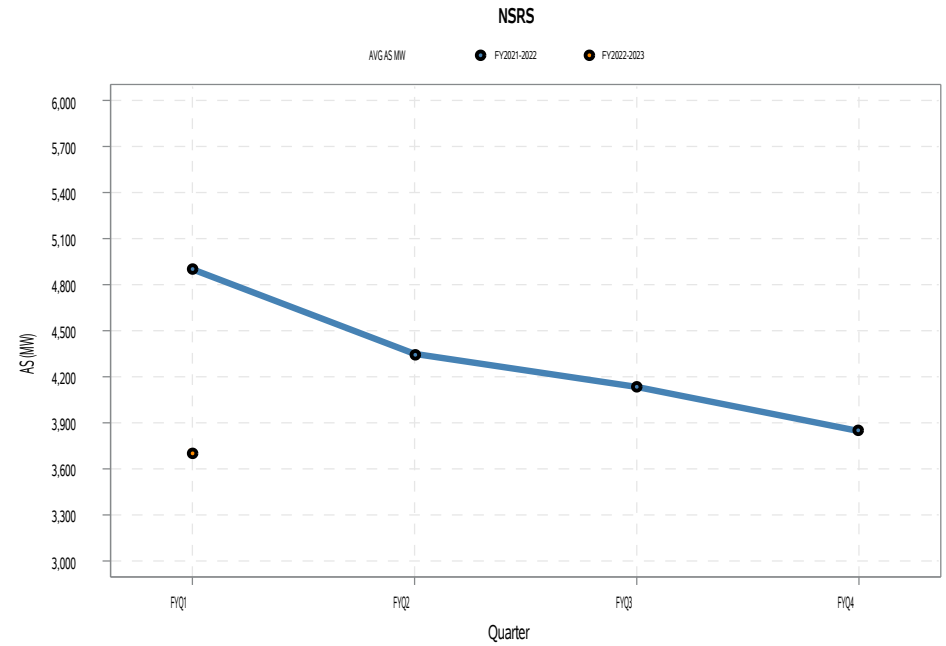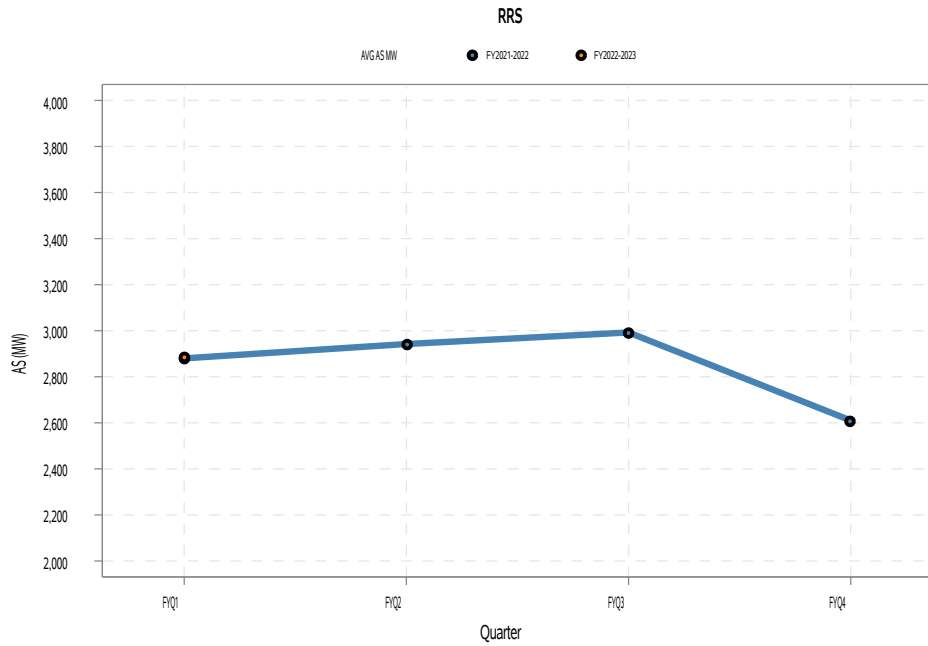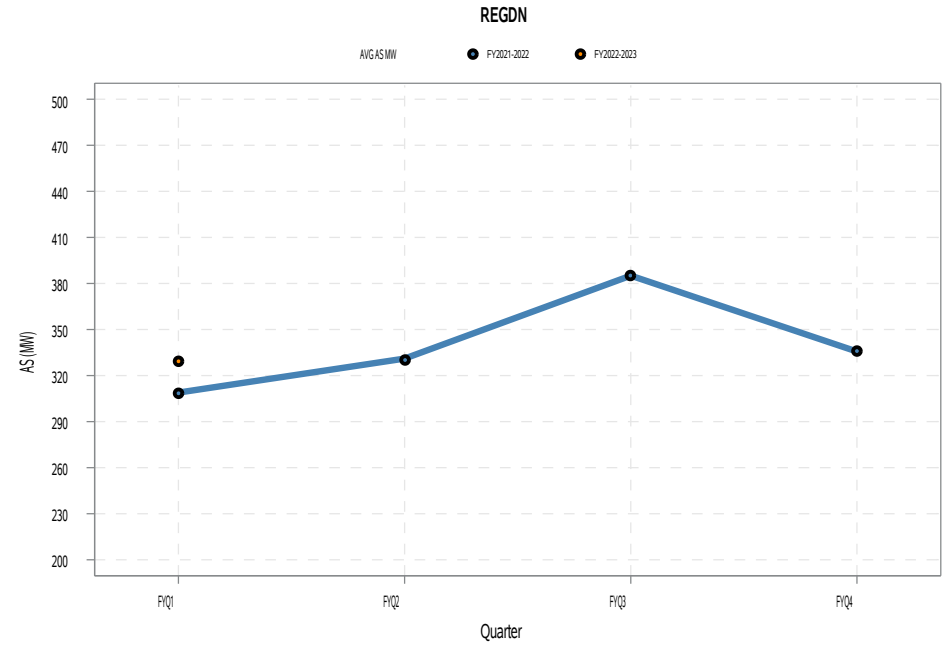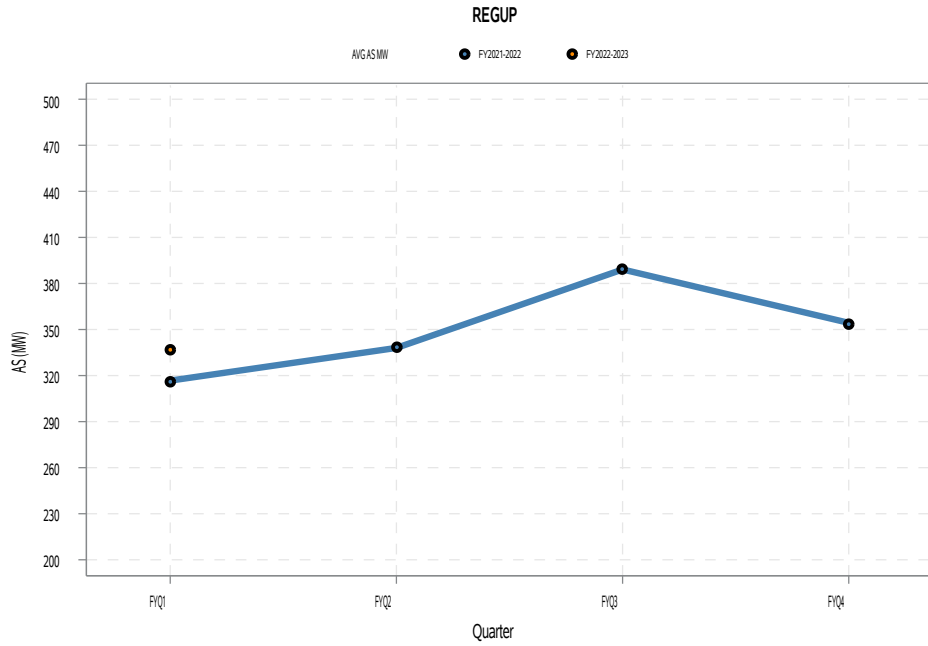

Quarterly Average of Ancillary Services Prices (MCPCs)

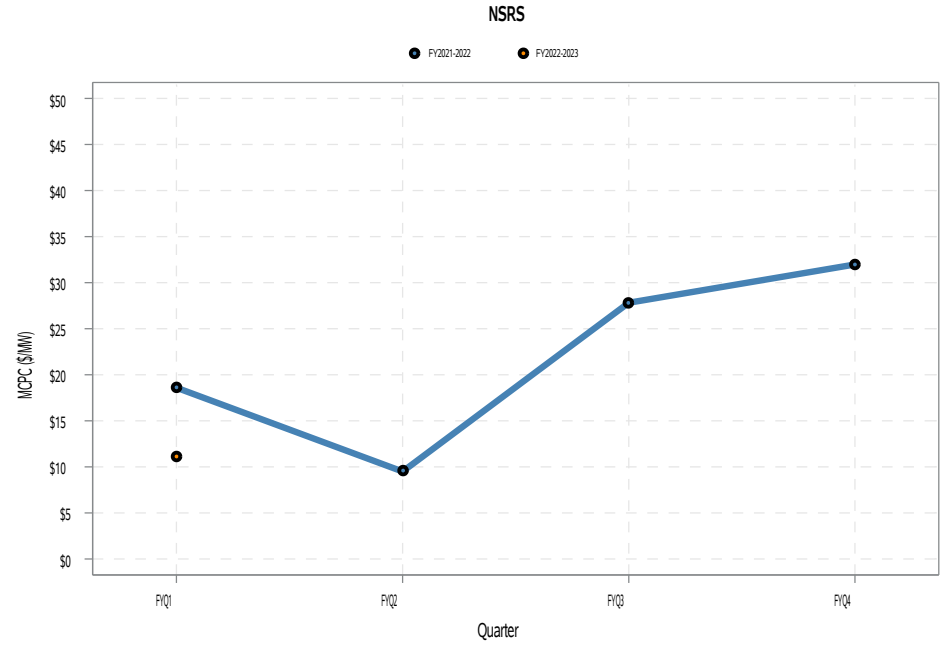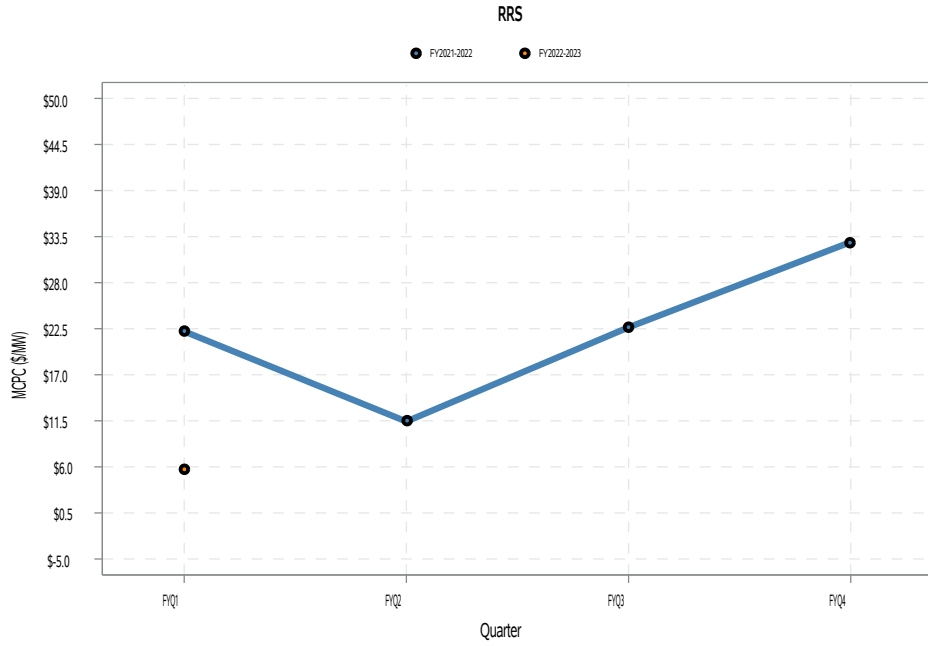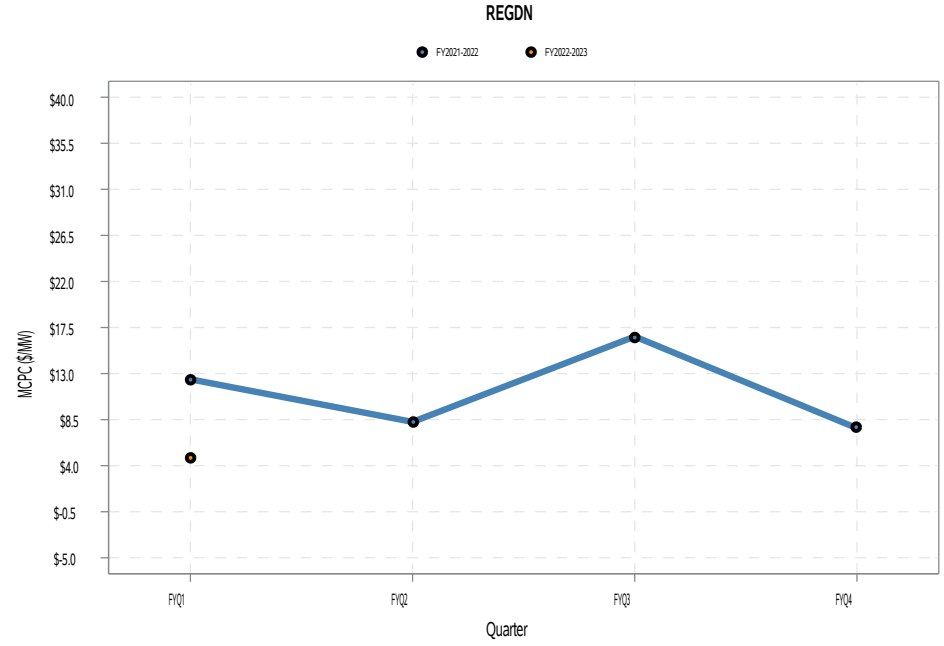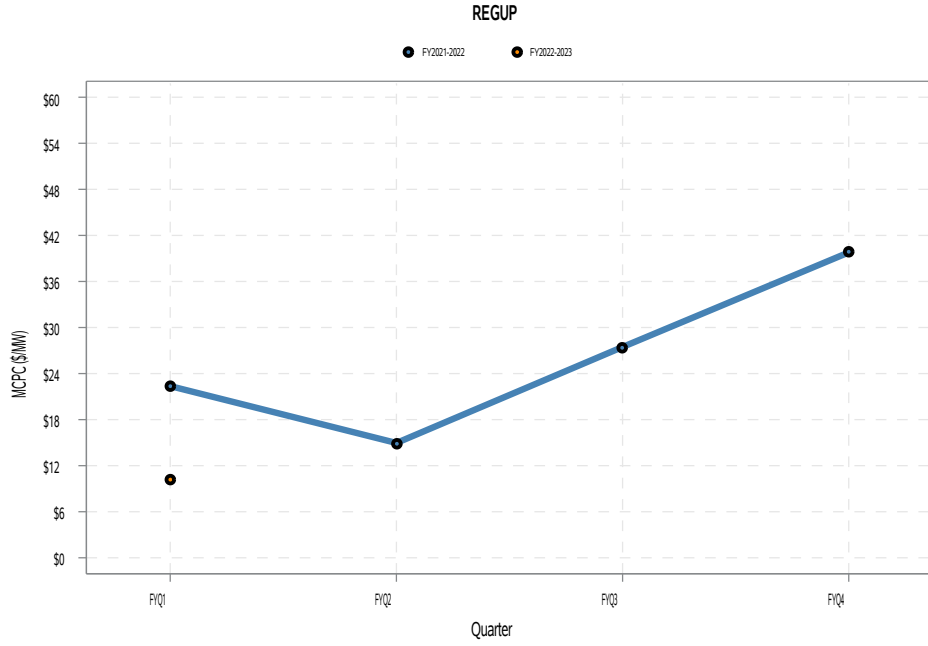


Quarterly Average Ancillary Services Cost per MWh Load

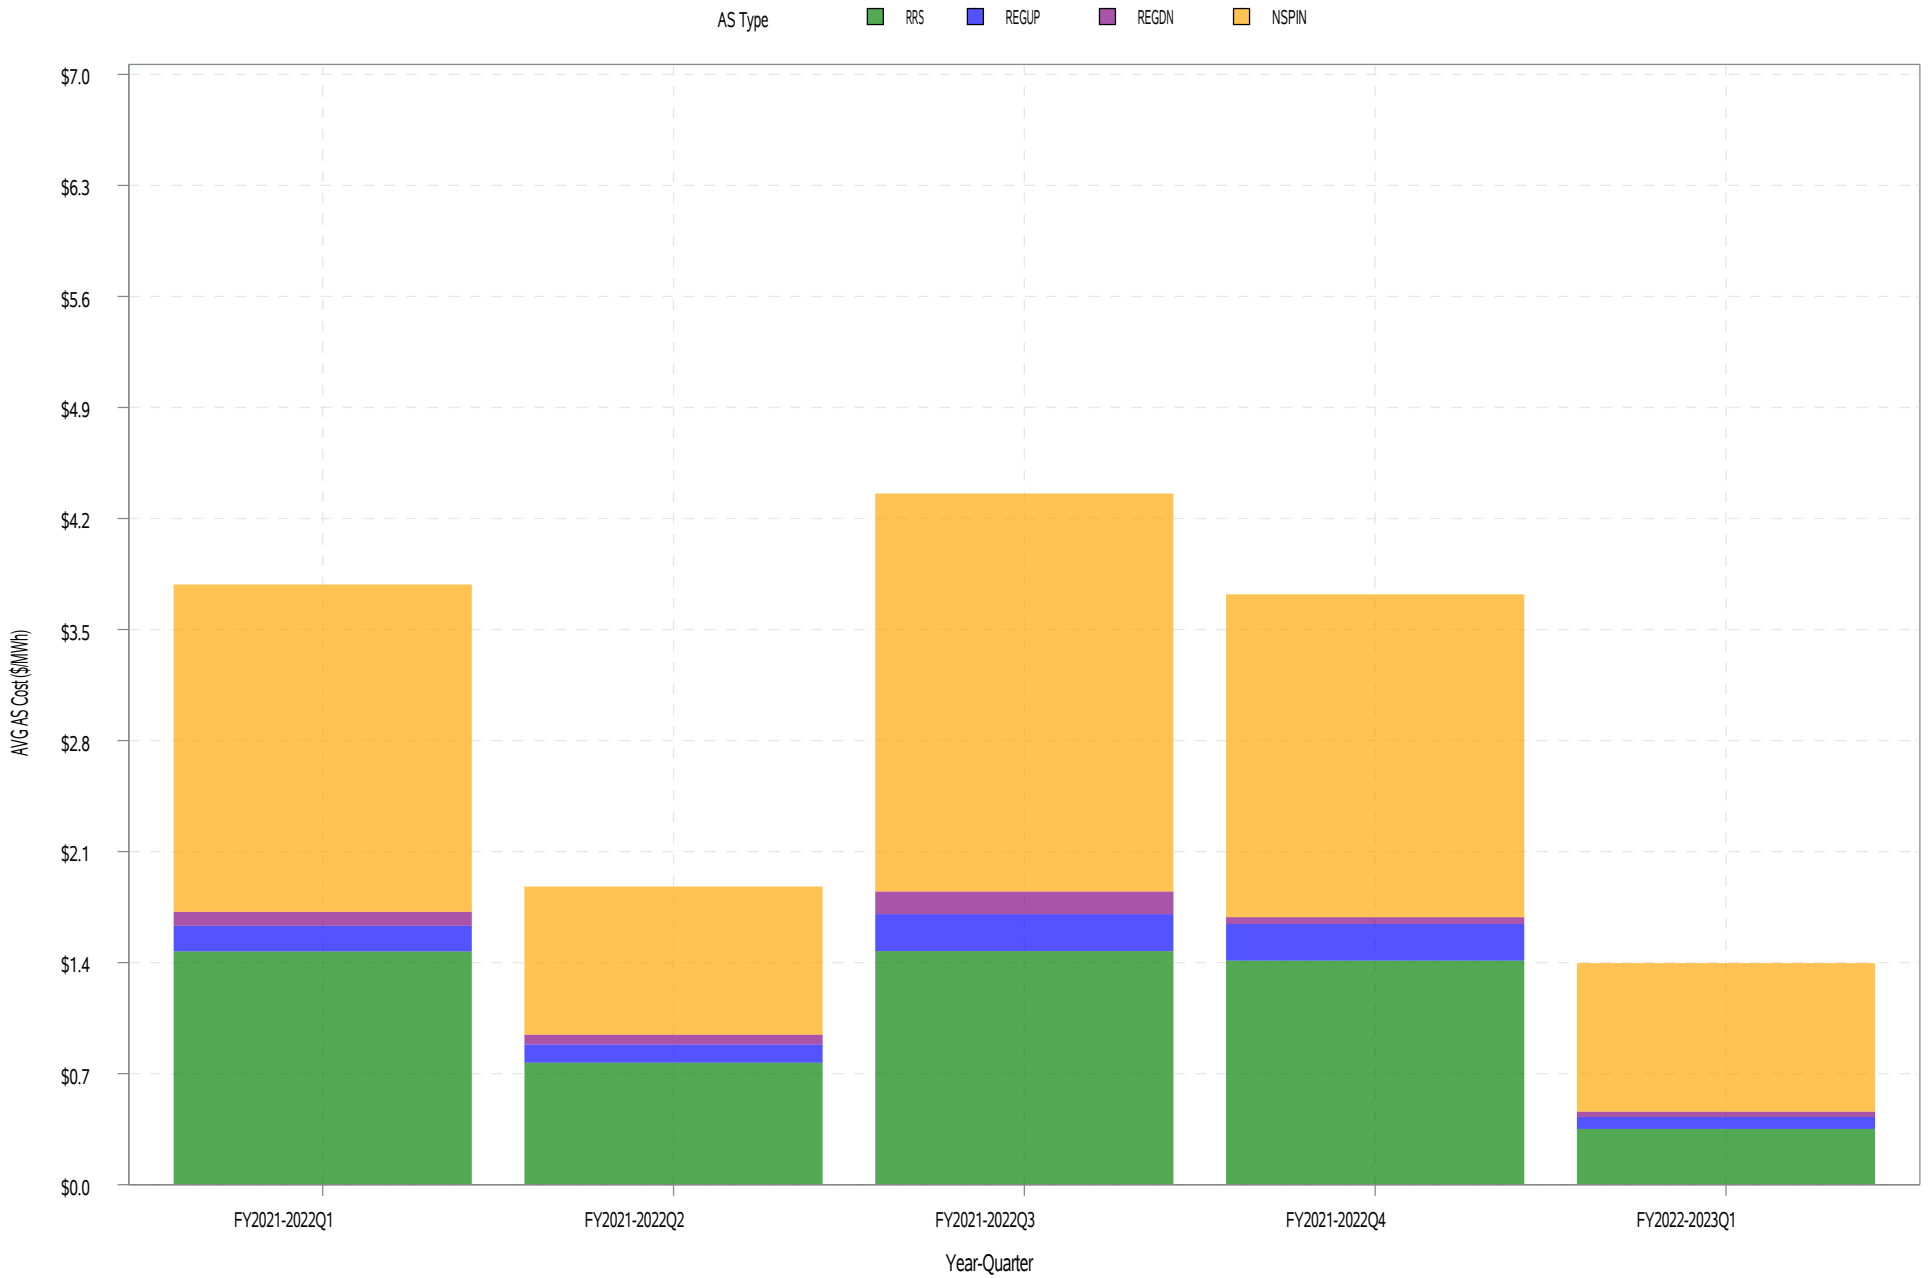

Quarterly Average DA vs. RT Load Forecast Error by Hour Ending

Positive values indicate that DA Load Forecast > RT Load

HE Type ● HE_9_12 ● HE_5_8 ● HE_21_24 ● HE_17_20 ● HE_13_16 ● HE_1_4

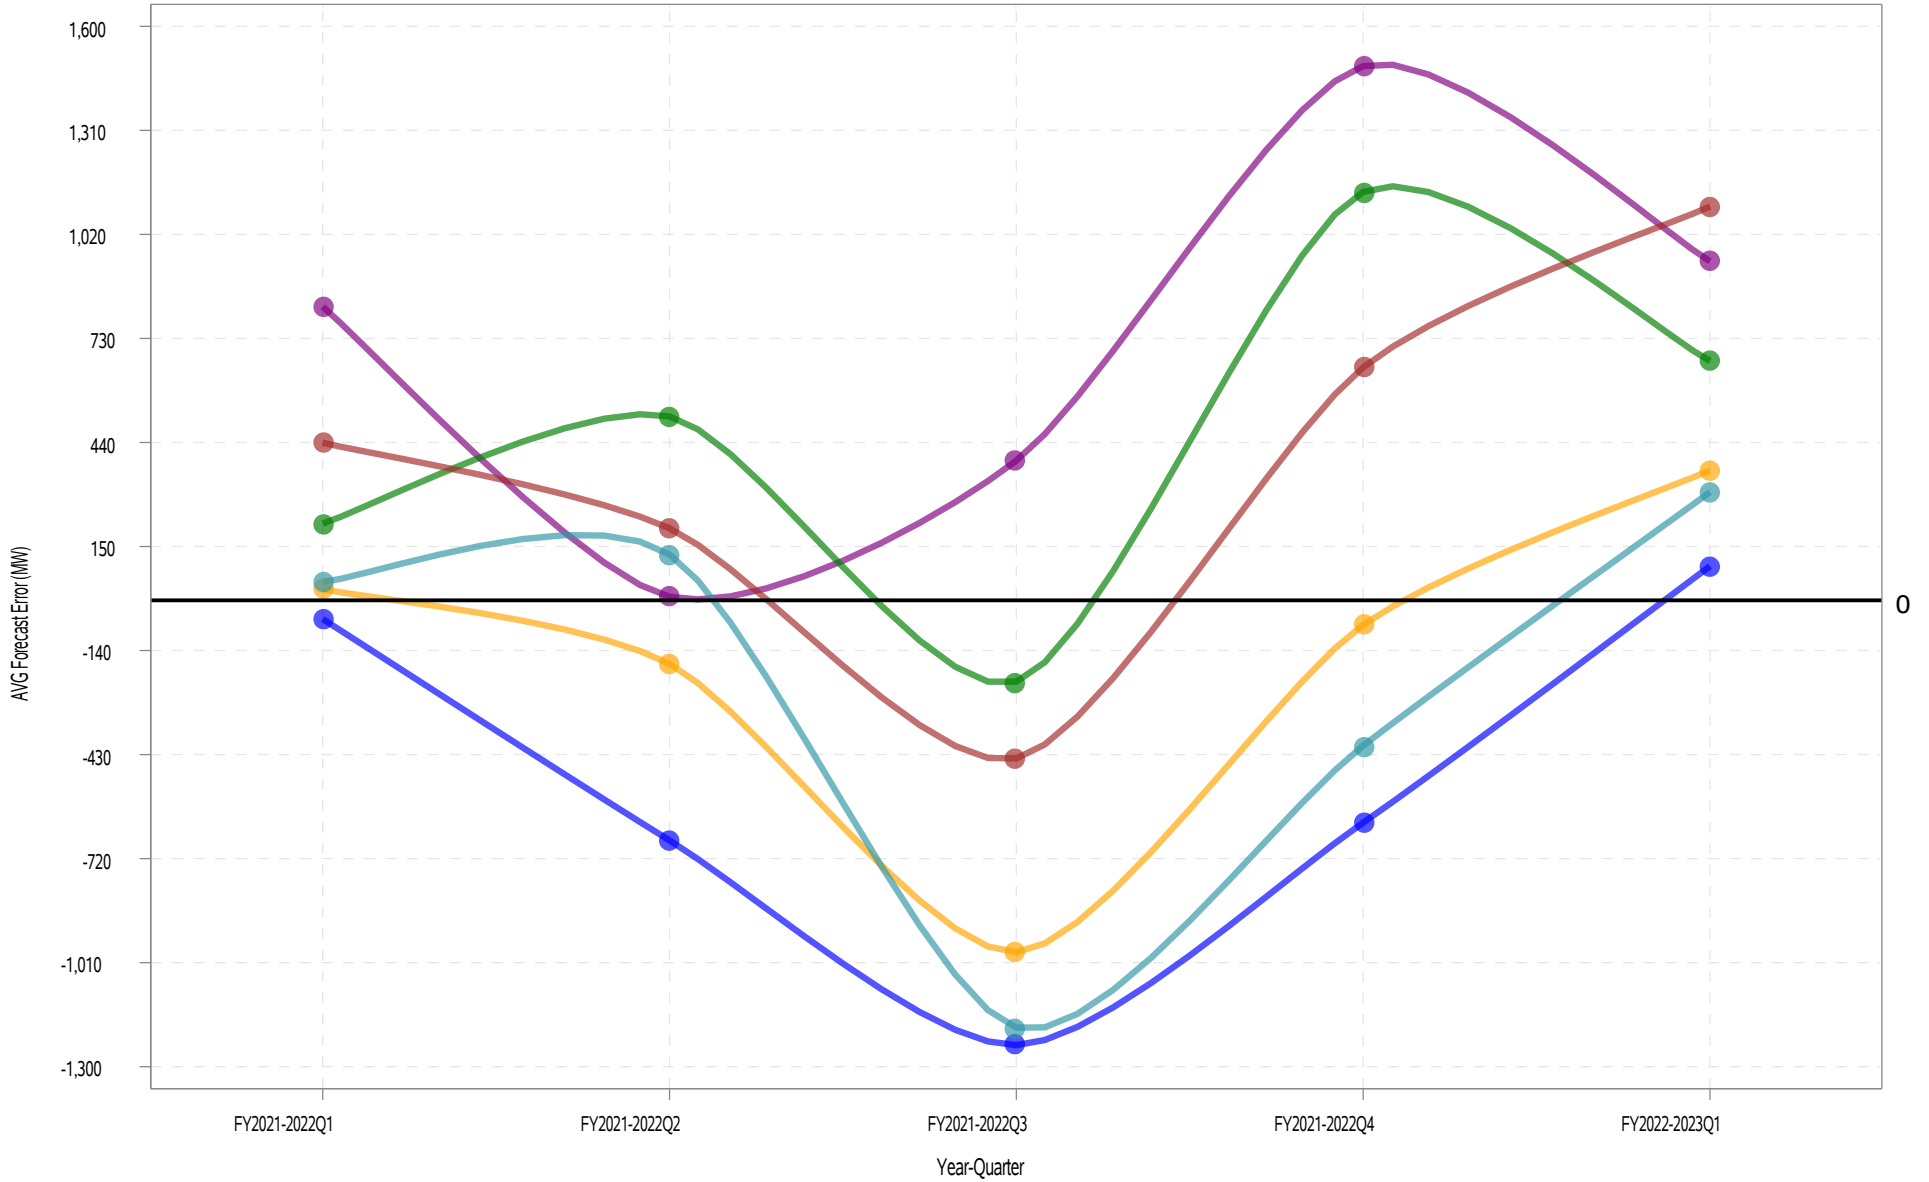

Quarterly Average of Wind Generation by Hour Ending

