



Average Energy Prices DA vs. RT


ERCOT-wide

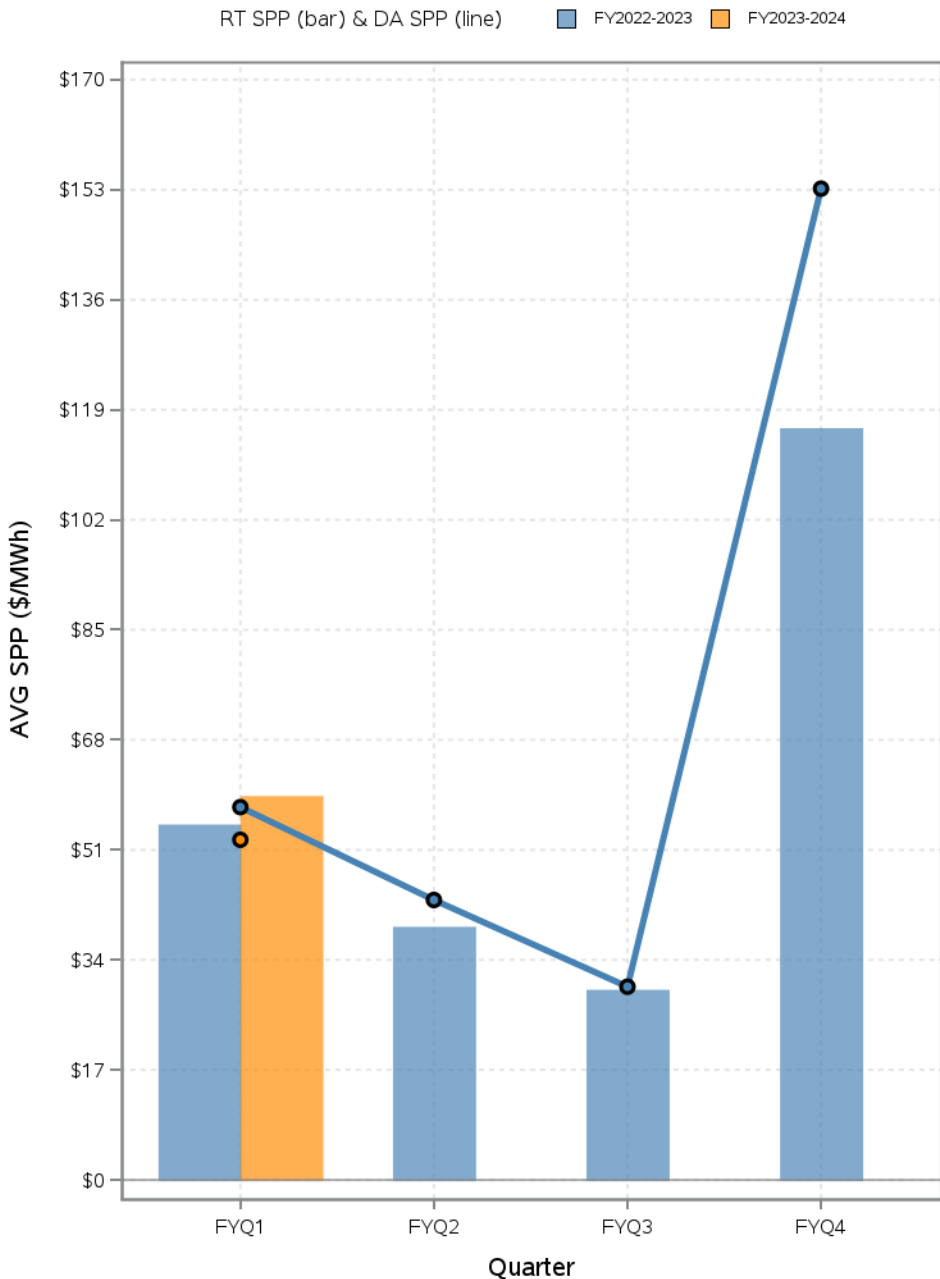


LZ Houston

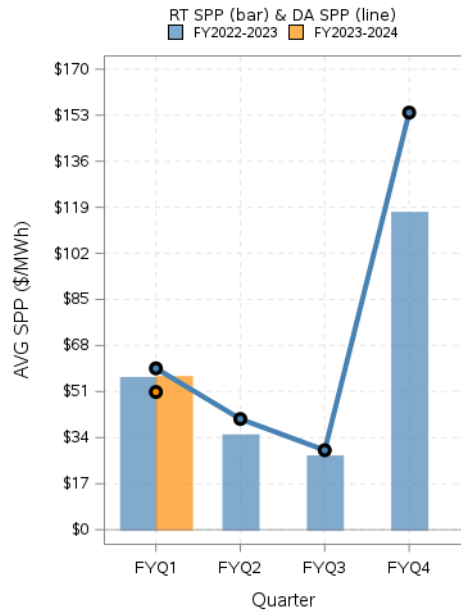


LZ North

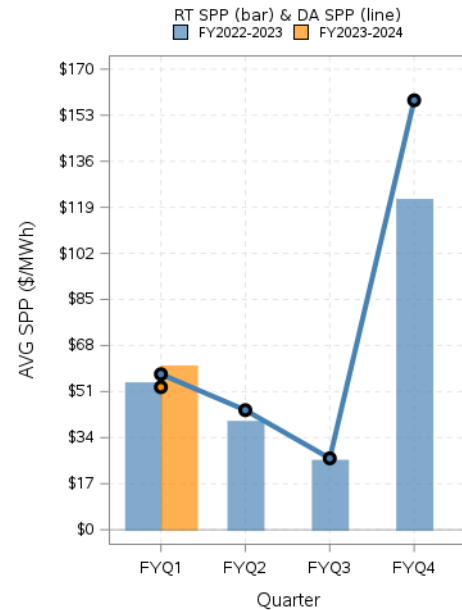

LZ South

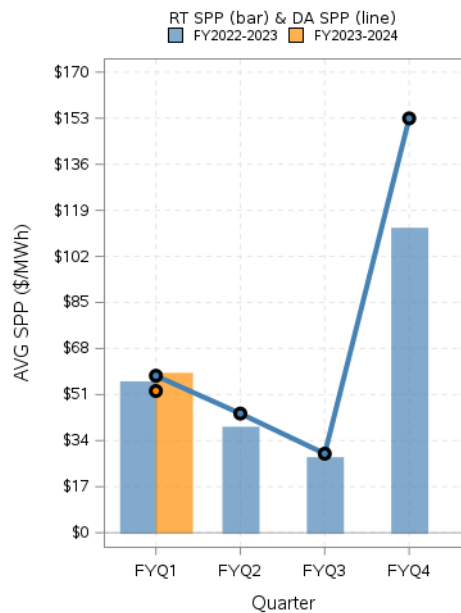


LZ West

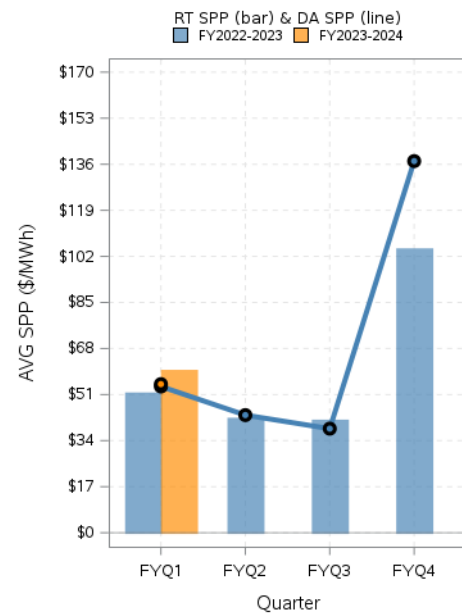


Average Heat Rates DA vs. RT


ERCOT-wide

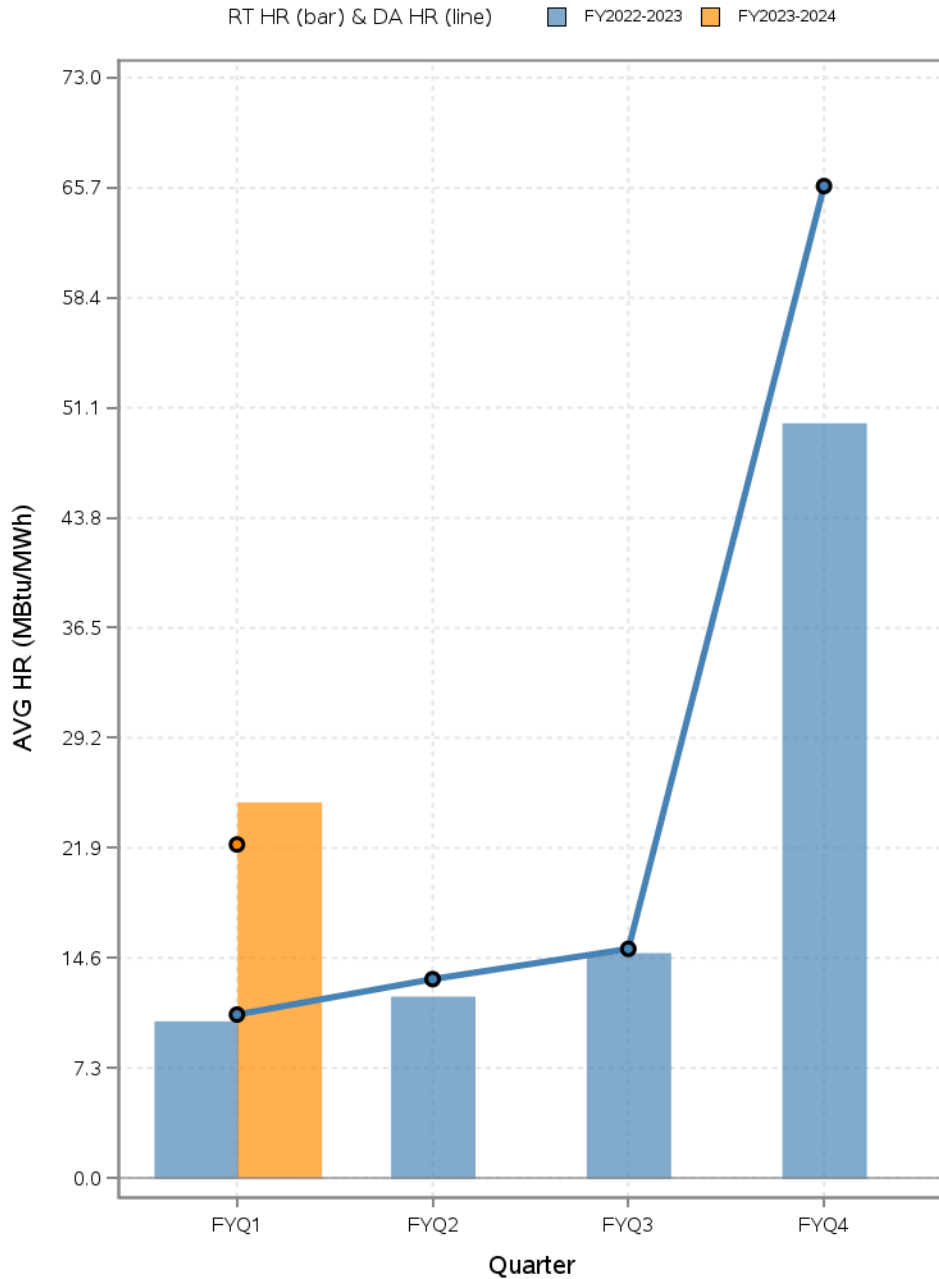


LZ Houston

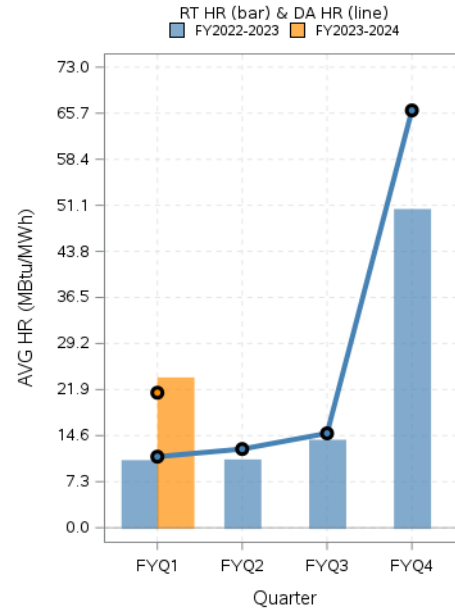


LZ North

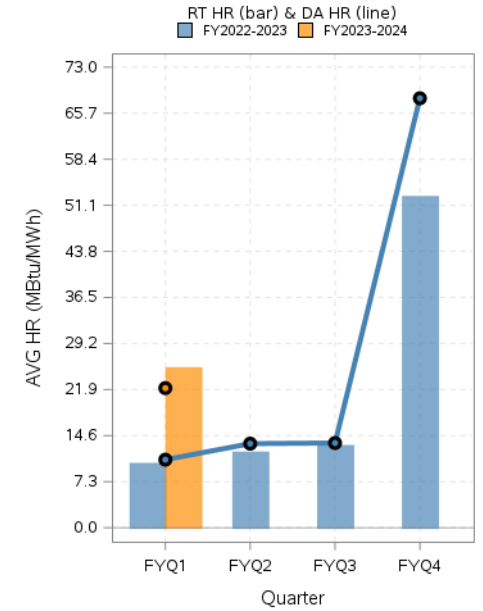

LZ South

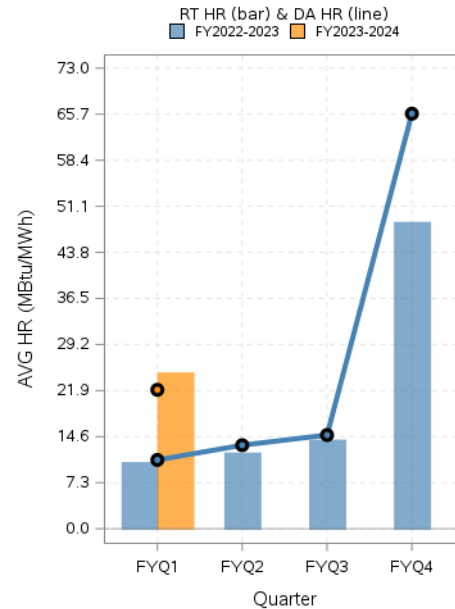


LZ West

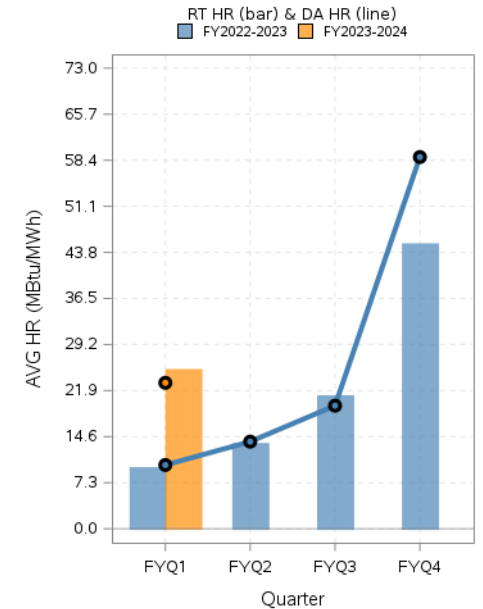


Load Zone Loads Averages vs. Peaks


LZ Houston

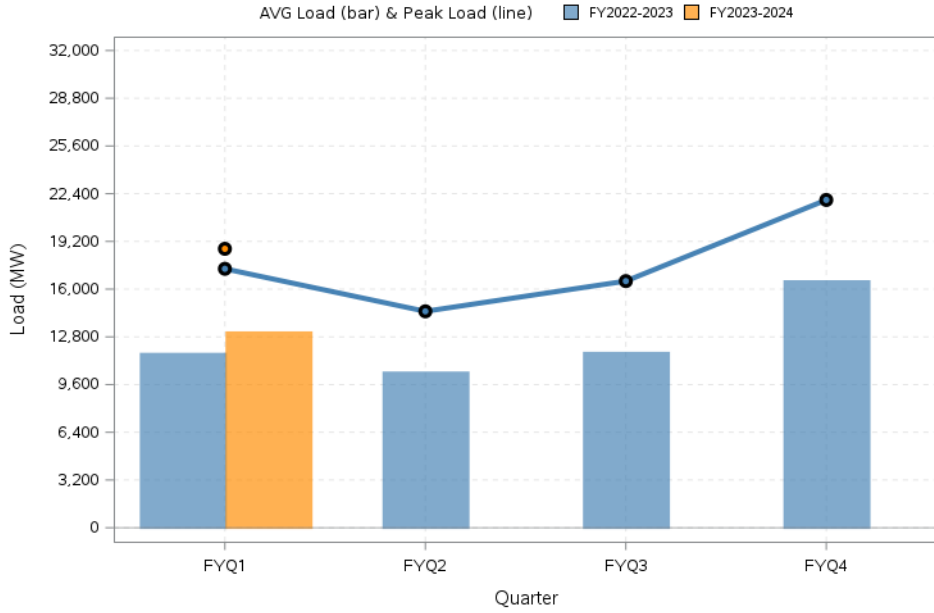


LZ North

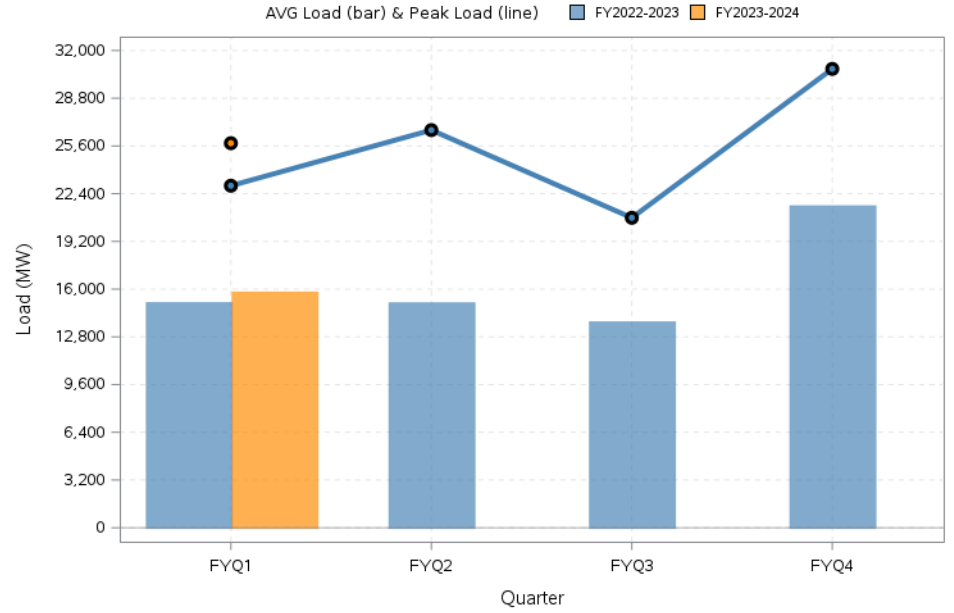



LZ South

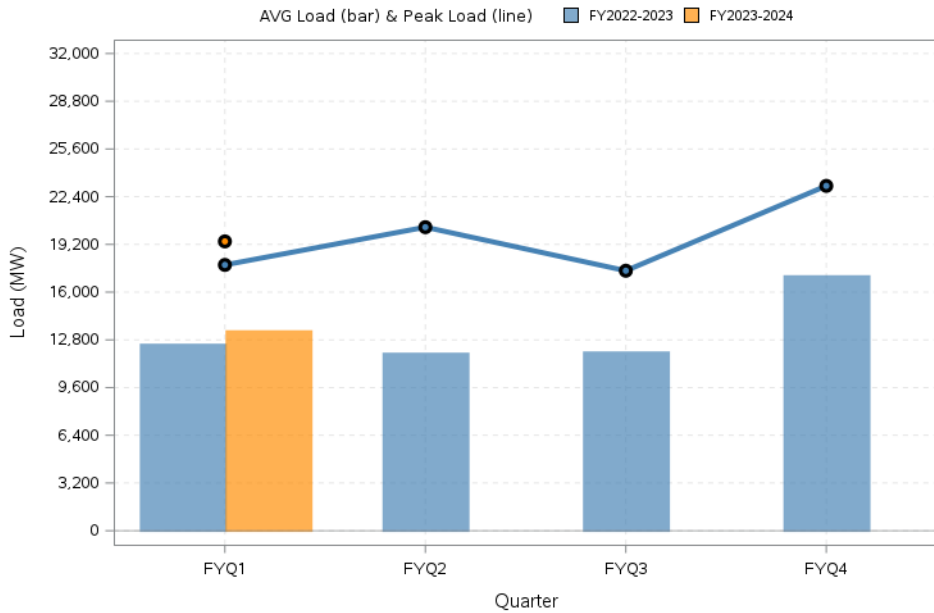






LZ West

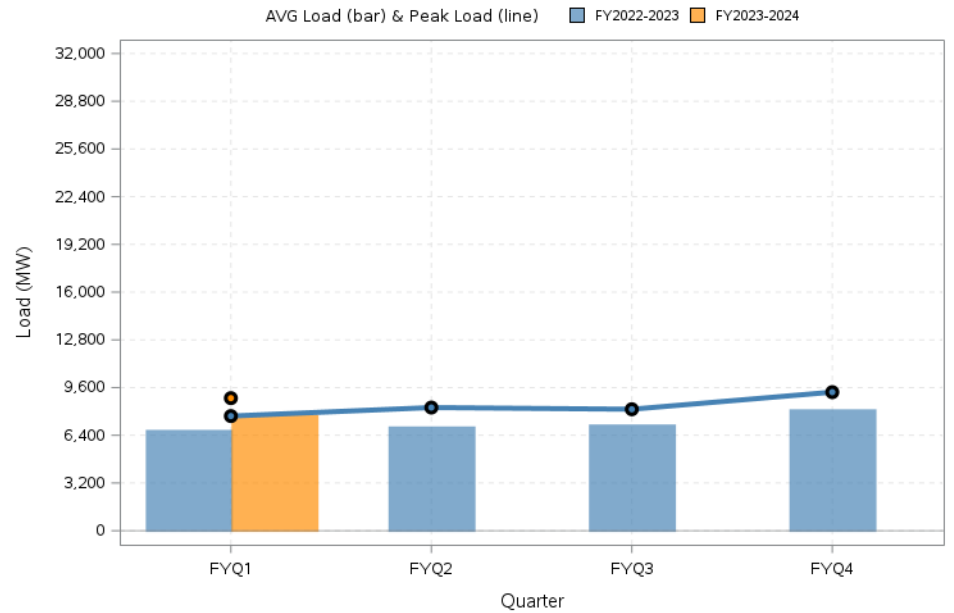






Daily ORDC Reserve/Reliability Adders Average Values in FY2023-2024Q1

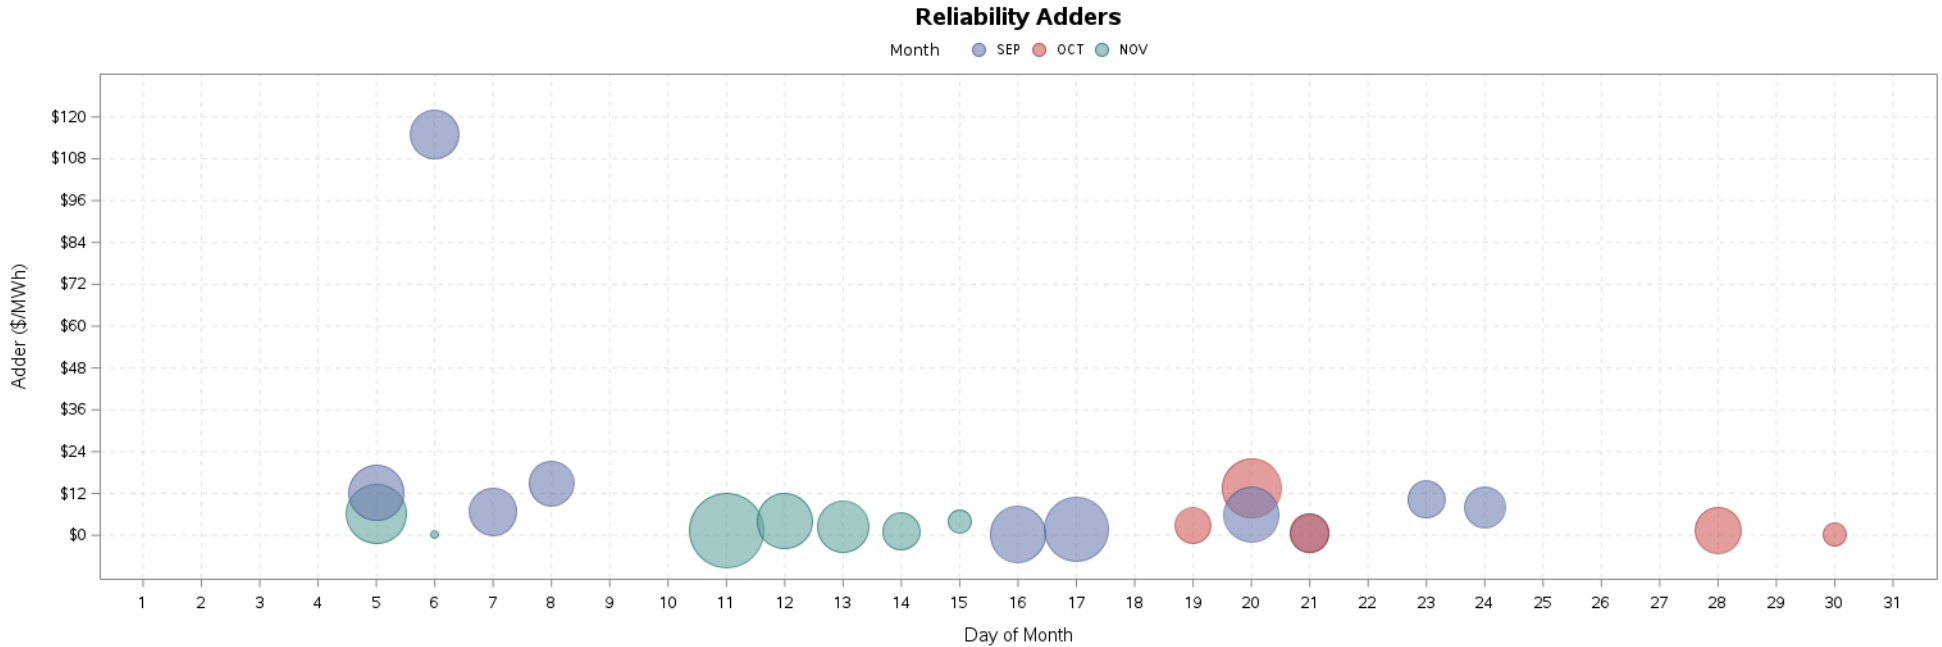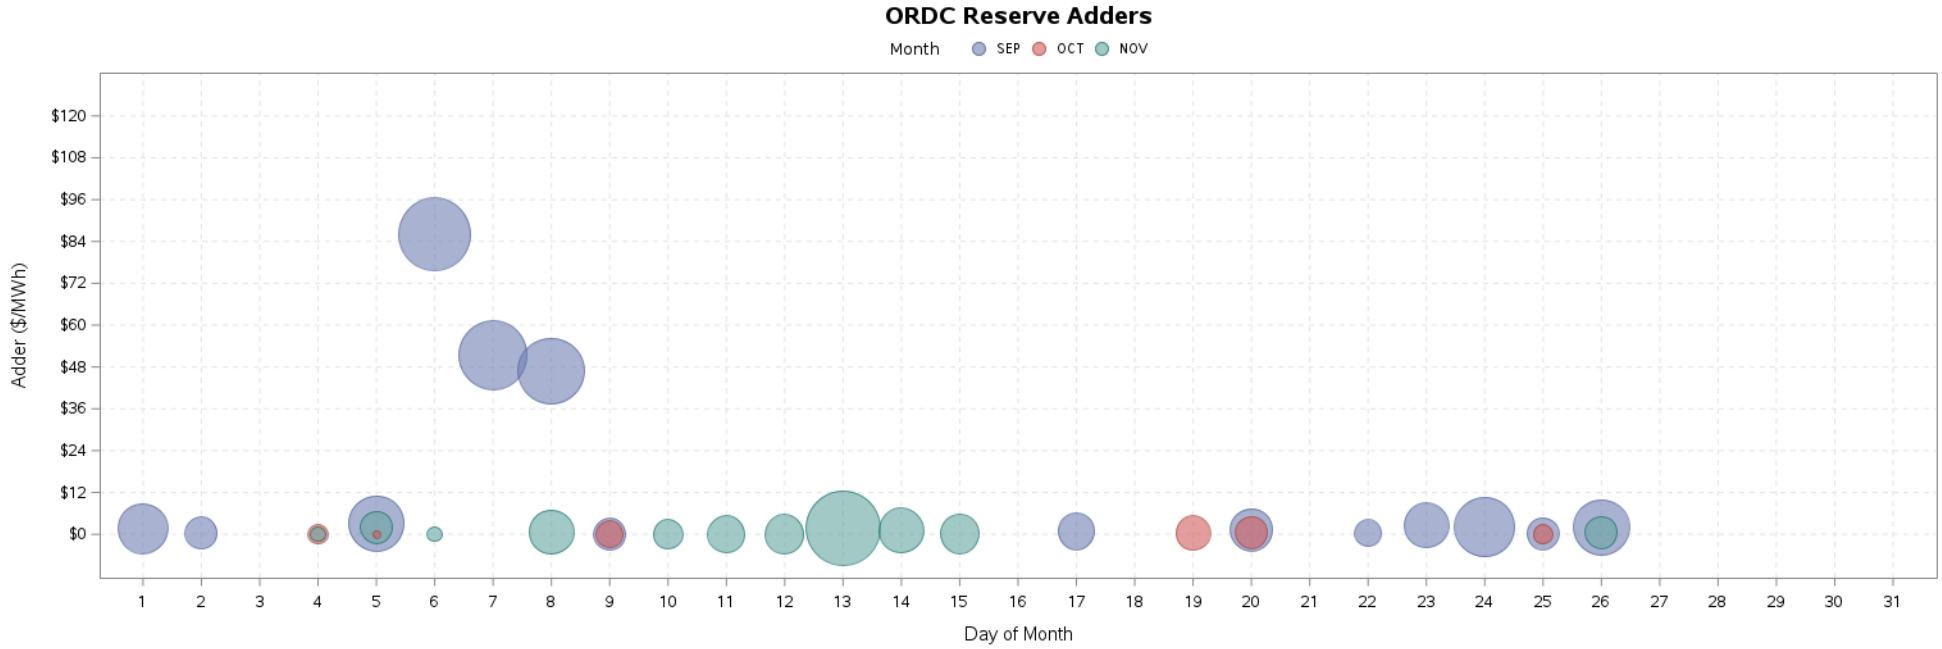


Quarterly Average of Ancillary Services Required MW

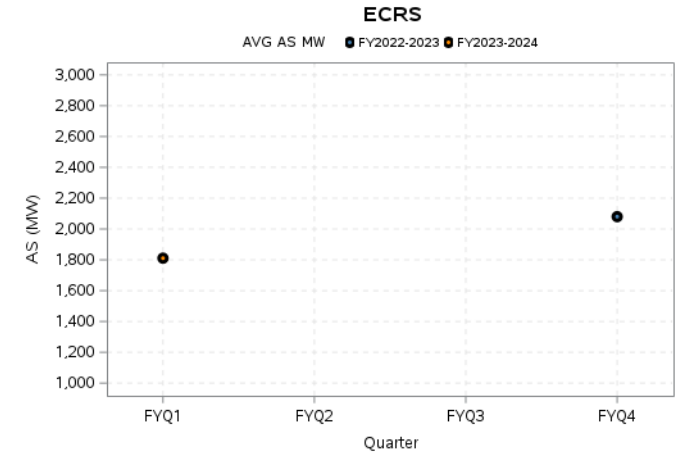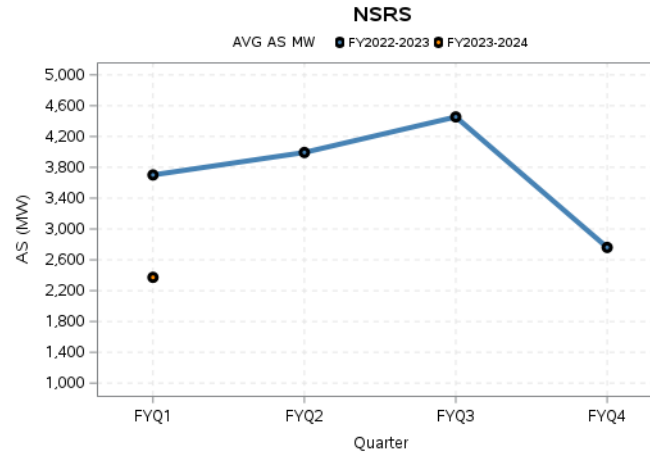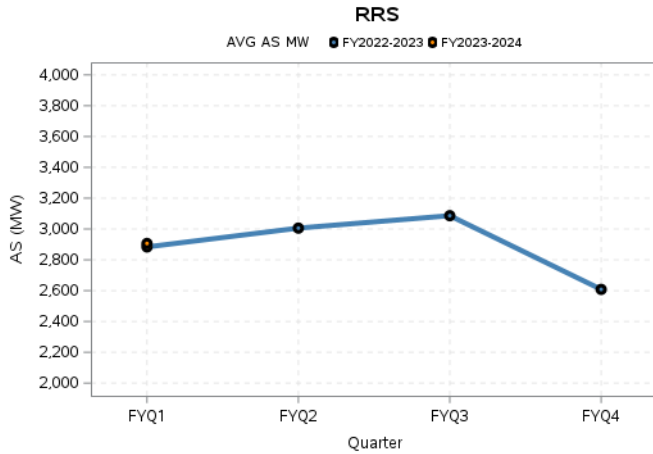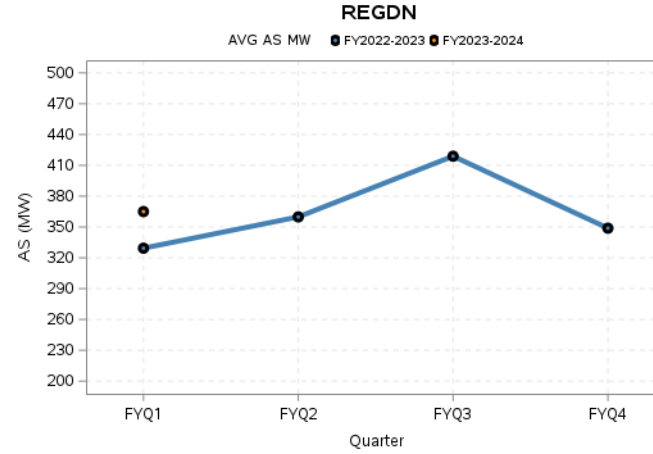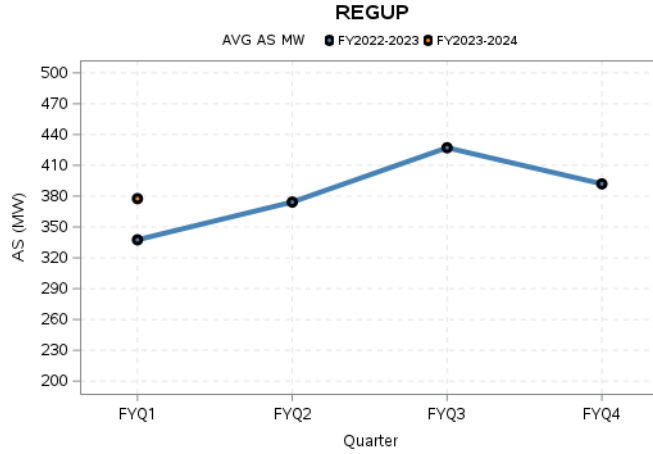

Quarterly Average of Ancillary Services Prices (MCPCs)

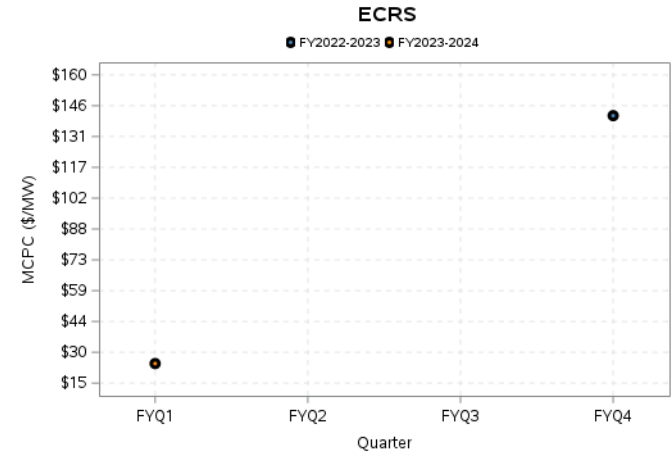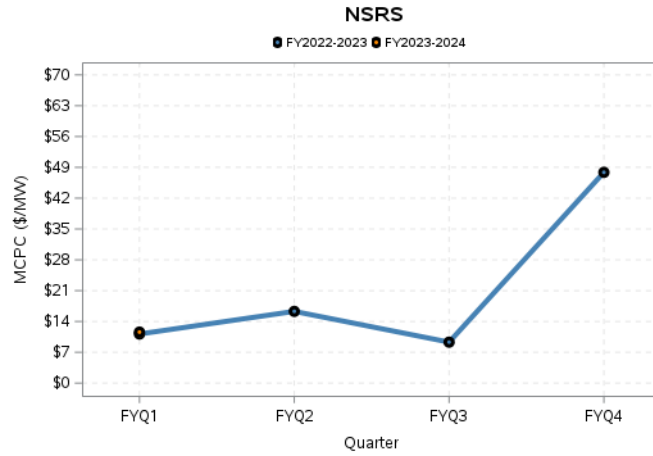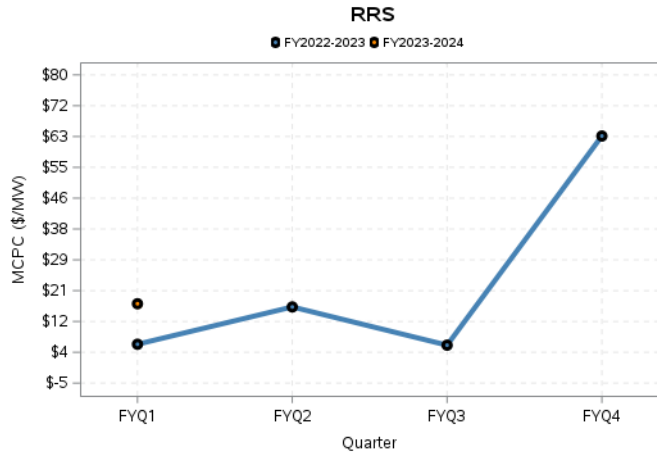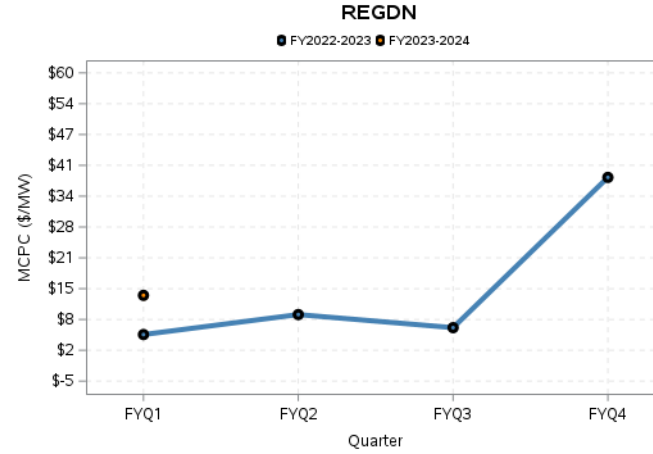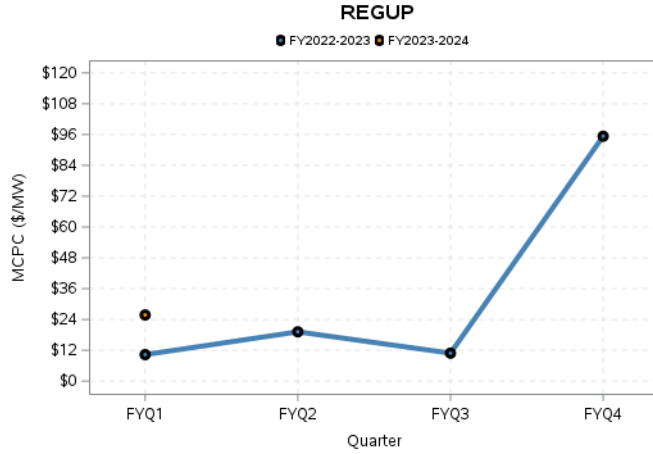


Quarterly Average Ancillary Services Cost per MWh Load

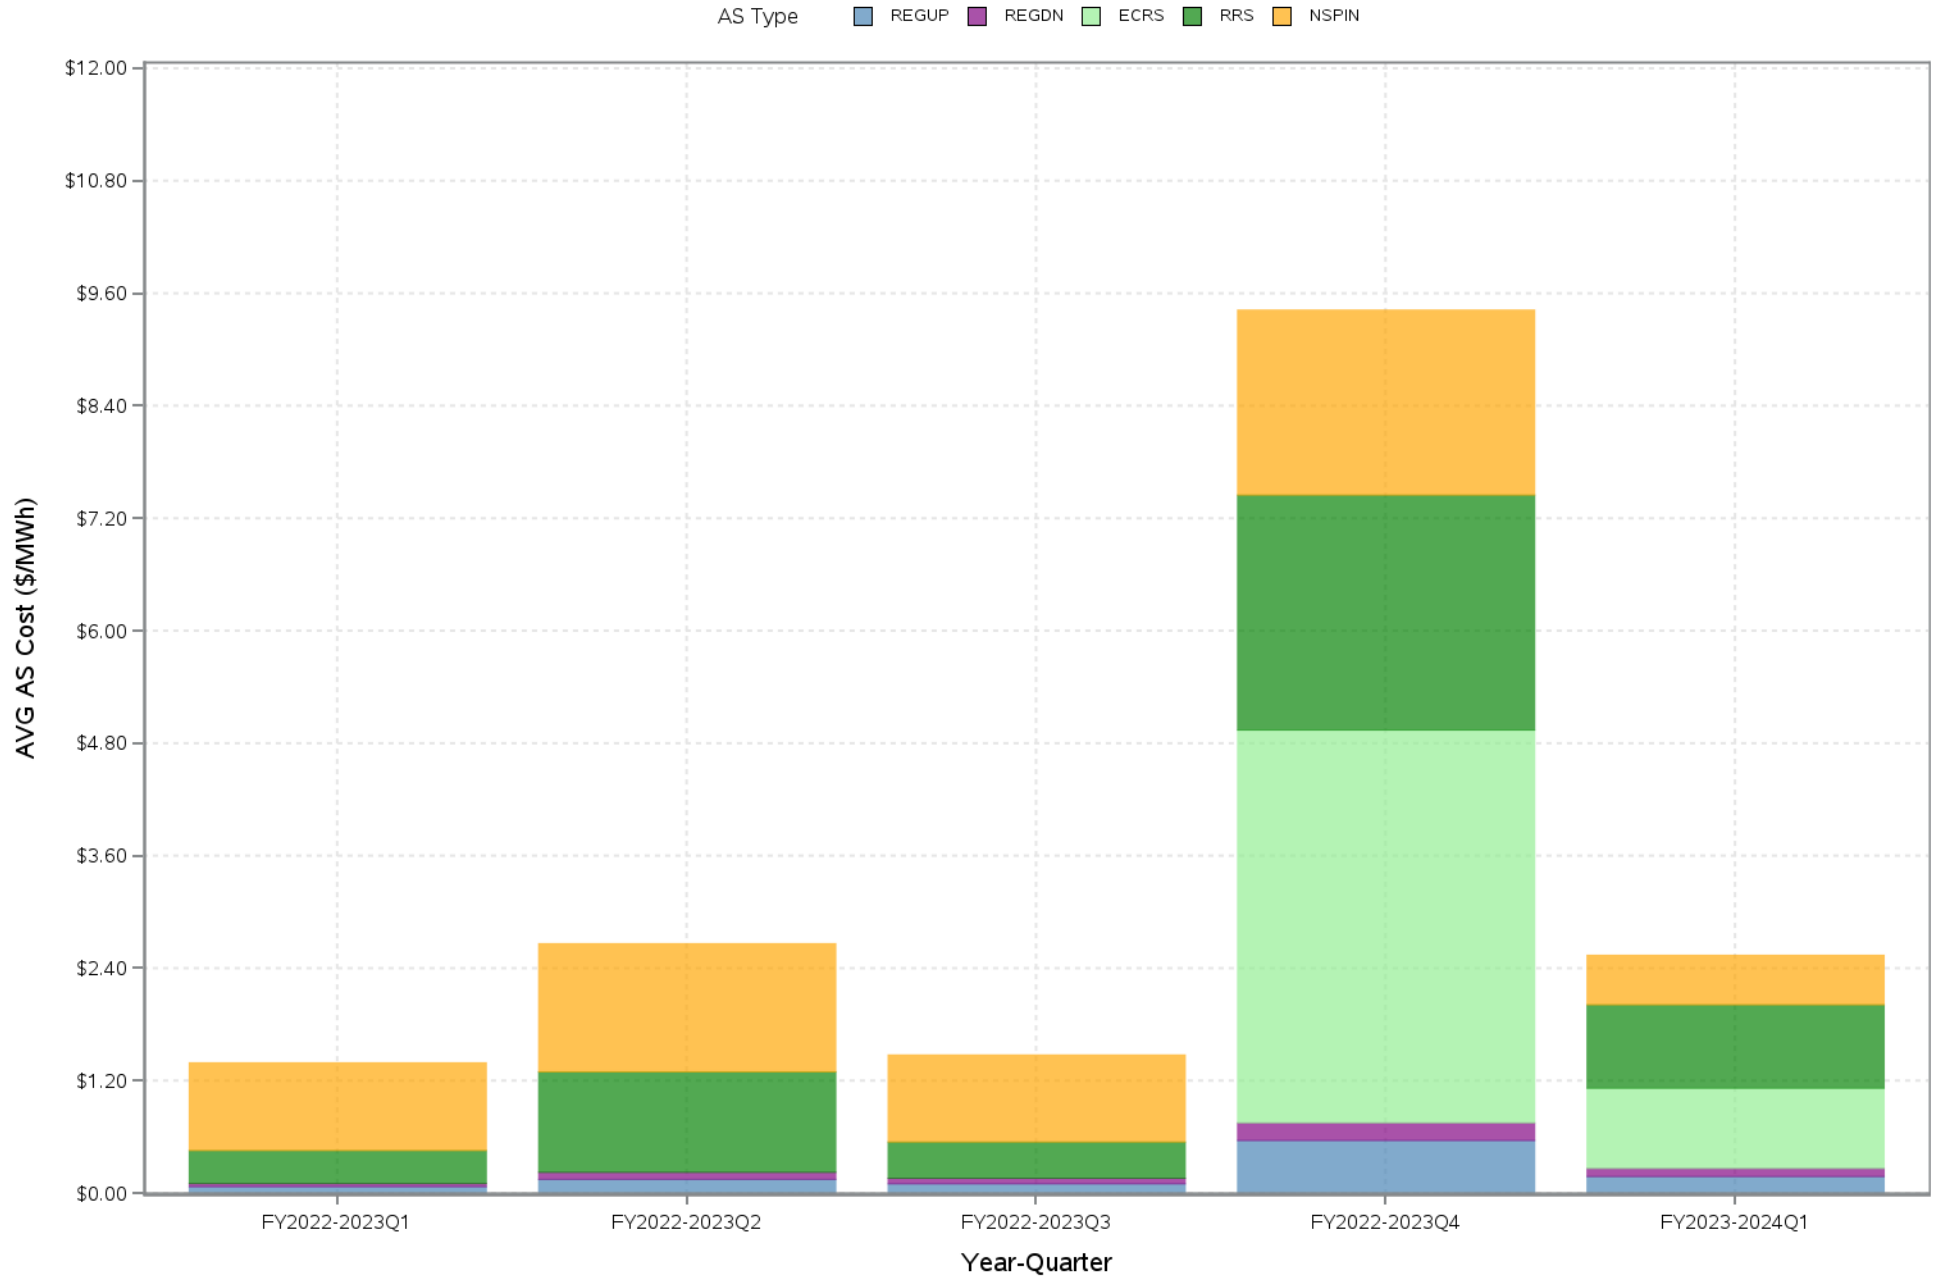

Quarterly Average DA vs. RT Load Forecast Error by Hour Ending

Positive values indicate that DA Load Forecast > RT Load

HE Type ● HE_9_12 ● HE_5_8 ● HE_21_24 ● HE_17_20 ● HE_13_16 ● HE_1_4

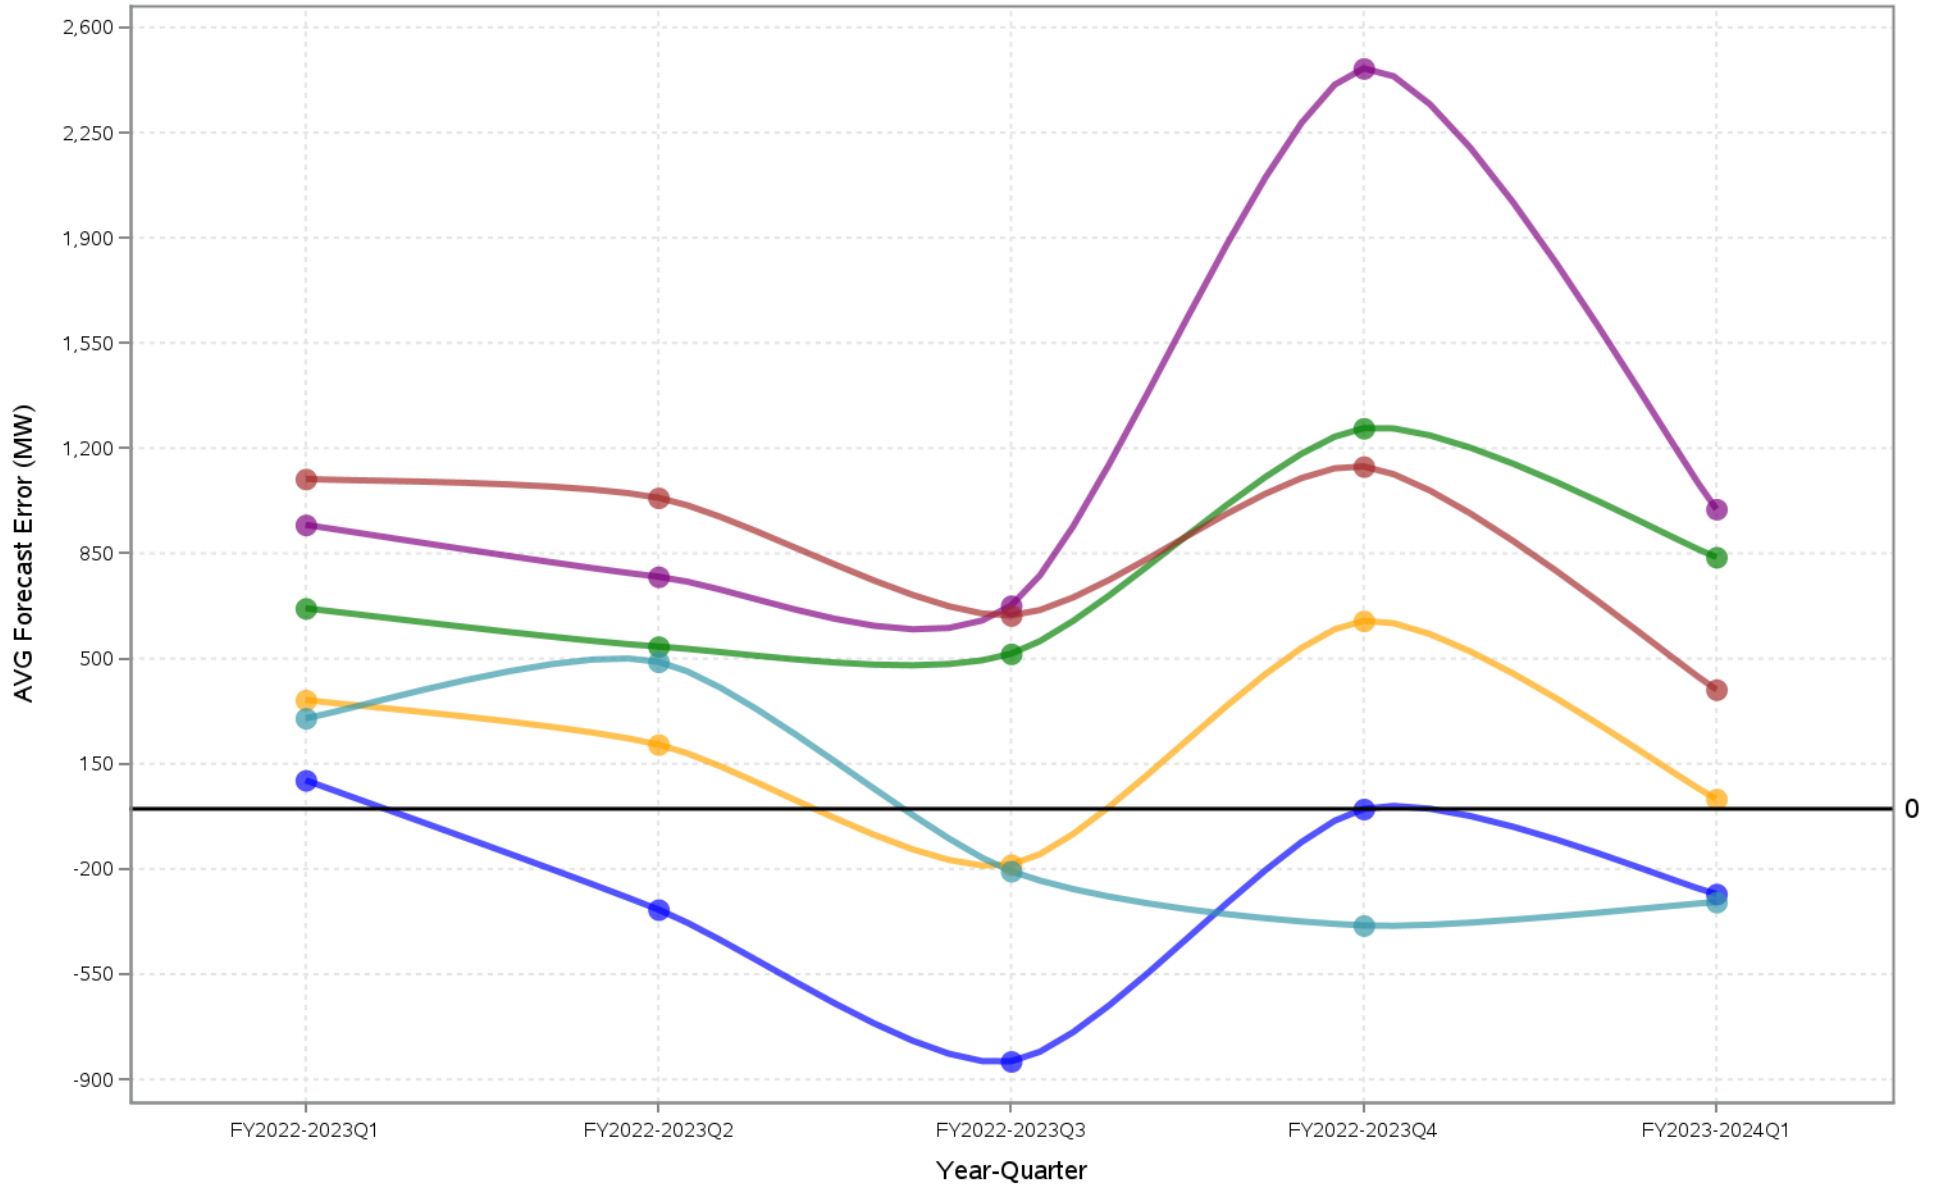

Quarterly Average of Wind Generation by Hour Ending

